


**LEGEND**

- EASEMENT LINE
- OVERHEAD TRANSMISSION LINE
- 13.8 KV 3PH OVERHEAD
- 13.8 KV 1PH OVERHEAD
- SECONDARIES OVERHEAD
- 13.8 KV 3PH UG - 6" CONDUIT- FEEDER CAP
- 13.8 KV 3PH UG - 5" CONDUIT- FEEDER CAP
- 13.8 KV 3PH UG - 4" CONDUIT
- 13.8 KV 1PH UNDERGROUND- 2" CONDUIT
- UNDERGROUND SECONDARIES
- INSTALLED CONDUIT
- FUTURE CONDUIT
- DIRECTION OF SERVICE
- EXISTING POLE LOCATION
- NEW POLE LOCATION
- #XXXXXX PADMOUNT TRANSFORMER
- ▲ POLEMOUNT TRANSFORMER
- P.T.S.
- F.U.G.
- F.D.
- B.D.
- N/C
- N/O
- #0000 SWITCH NUMBER
- \* STREET LIGHT
- HIGH VOLTAGE TERMINAL
- SECONDARY PEDESTAL
- S&C PME SWITCH GEAR
- ND SECTIONALIZER TERMINAL
- PULL BOX
- FAULT INDICATOR

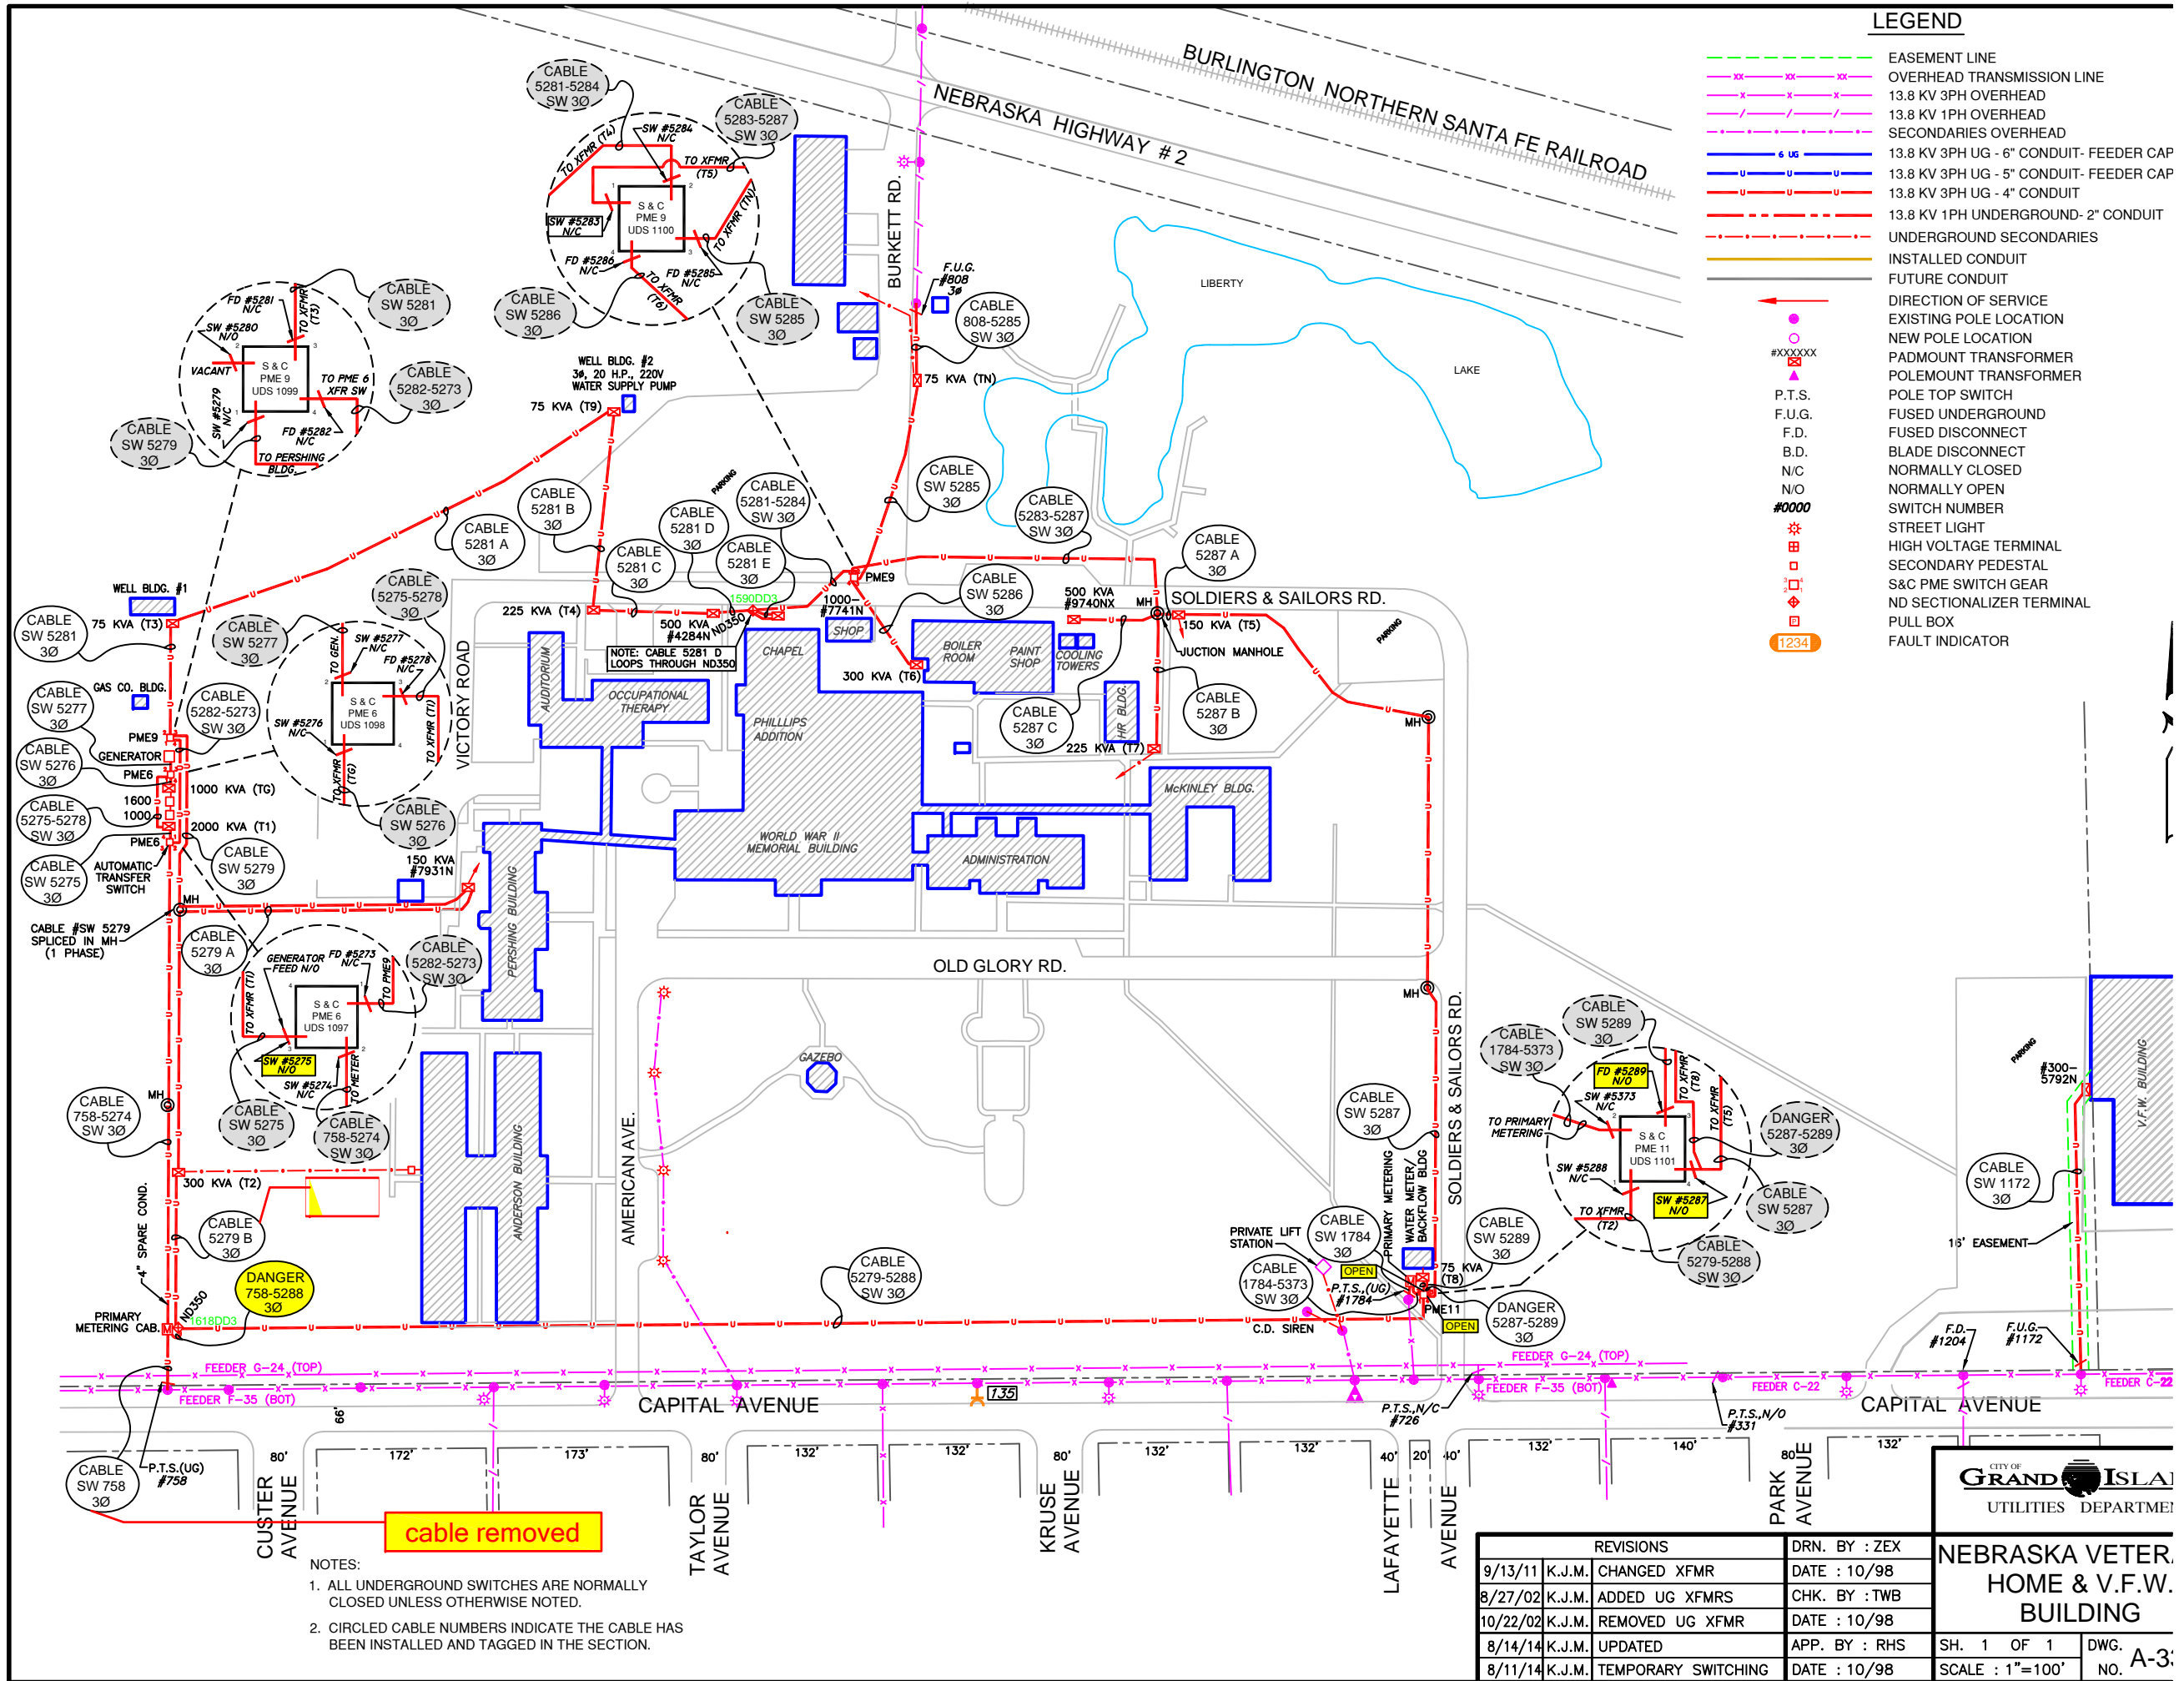

REVISIONS		DRN. BY : ZEX
9/13/11	K.J.M. CHANGED XFMR	DATE : 10/98
8/27/02	K.J.M. ADDED UG XFMRs	CHK. BY : TWB
10/22/02	K.J.M. REMOVED UG XFMR	DATE : 10/98
8/14/14	K.J.M. UPDATED	APP. BY : RHS
8/11/14	K.J.M. TEMPORARY SWITCHING	DATE : 10/98

**CITY OF GRAND ISLA**  
 UTILITIES DEPARTMENT

**NEBRASKA VETERAN HOME & V.F.W. BUILDING**

SH. 1 OF 1 DWG. NO. A-3