123447 OR
Synthetic Ice Rink E. T. Mahoney

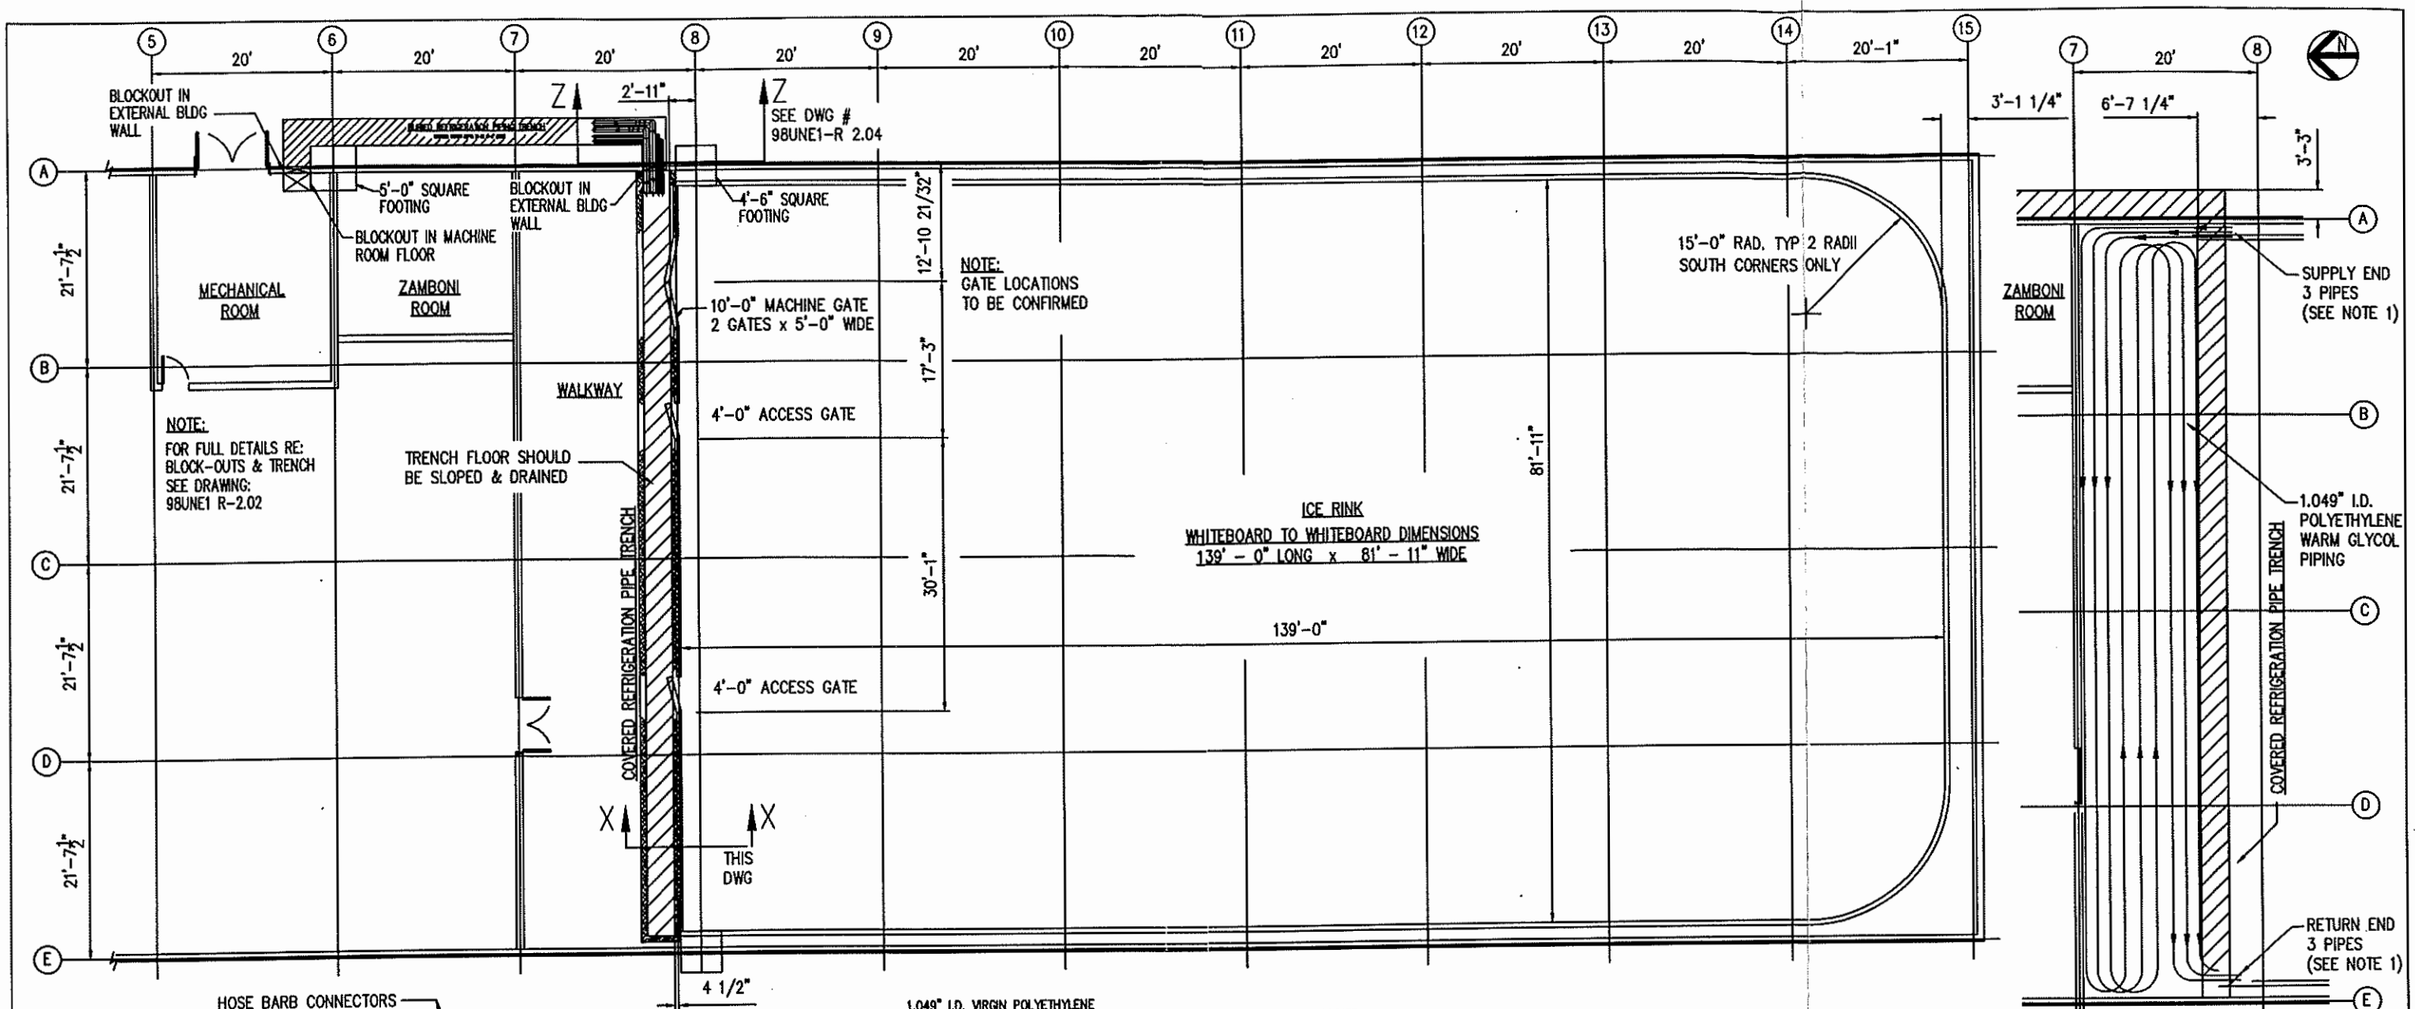

NORTH END
PERIMETER SLAB HEATING

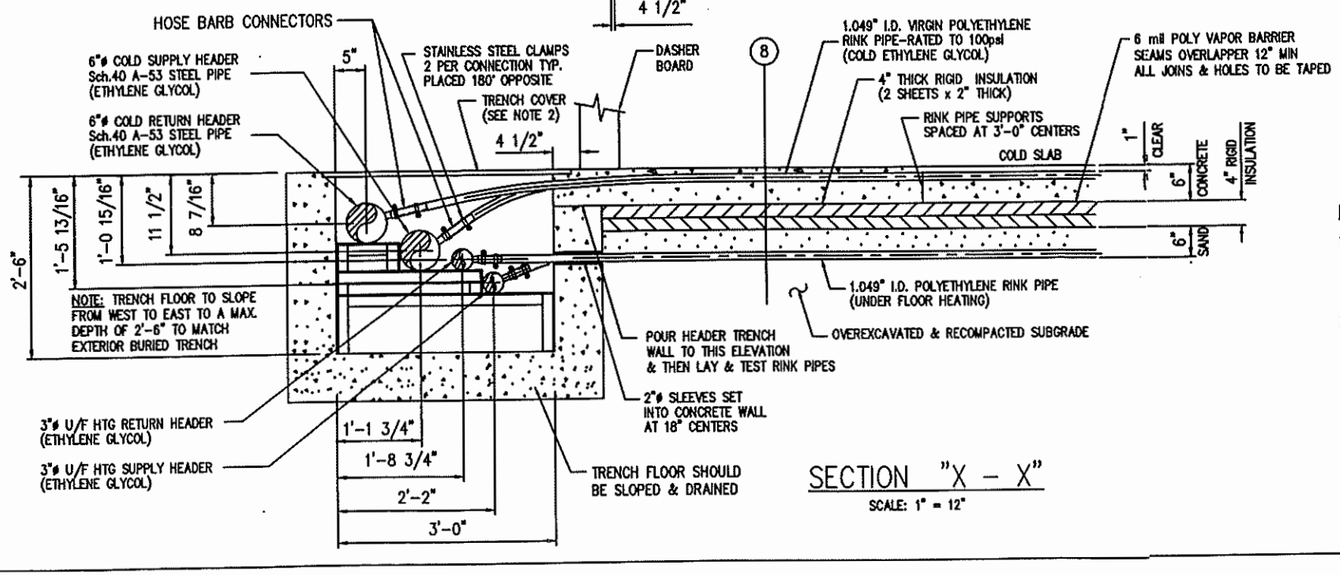

SECTION "X - X"
SCALE: 1" = 12"

NOTES:

1/. REFRIGERATION CONTRACTOR REQUIRES ONE 4" SLEEVE ON THE BACK WALL OF THE HEADER TRENCH AT EACH END TO ALLOW PASSAGE OF THE HEATING PIPES FOR THE NORTH END PERIMETER SLAB HEATING

2/. TRENCH COVER SHOULD BE CONSTRUCTED IN SECTIONS OF MANAGABLE SIZE AND OF AN INSULATING MATERIAL SUCH AS WOOD. STEEL PLATING OR OTHER SUITABLE MATERIALS SHOULD BE USED WHERE THE ICE RESURFACER CROSSES THE HEADER TRENCH.

REV	DATE	DESCRIPTION
3	AUG.24/98	WARM HEADER IN TRENCH REV'D
2	AUG.17/98	RINK GATES ADDED
1	JUNE30/98	REV'S TO COLD SLAB MAT'L THICKNESS
0		ORIGINAL

IcePro
#302 - 12761 - 96th Avenue
South Surrey British Columbia
Canada V3V 4T4

LOCATION: ACTIVITY CENTER, EUGENE T. MAHONEY STATE PARK, ASHLAND, NE, USA

TITLE: REFRIGERATION SYSTEM COLD FLOOR LAYOUT

DRAWN	CHECKED	DATE	SCALE	SHEET	DRAWING NUMBER	REV
R. LAYCOCK	R.JACKSON	JUNE23/98	1/8"=12" (UNO)	1 OF 1	98UNE1 R-2.00	3