





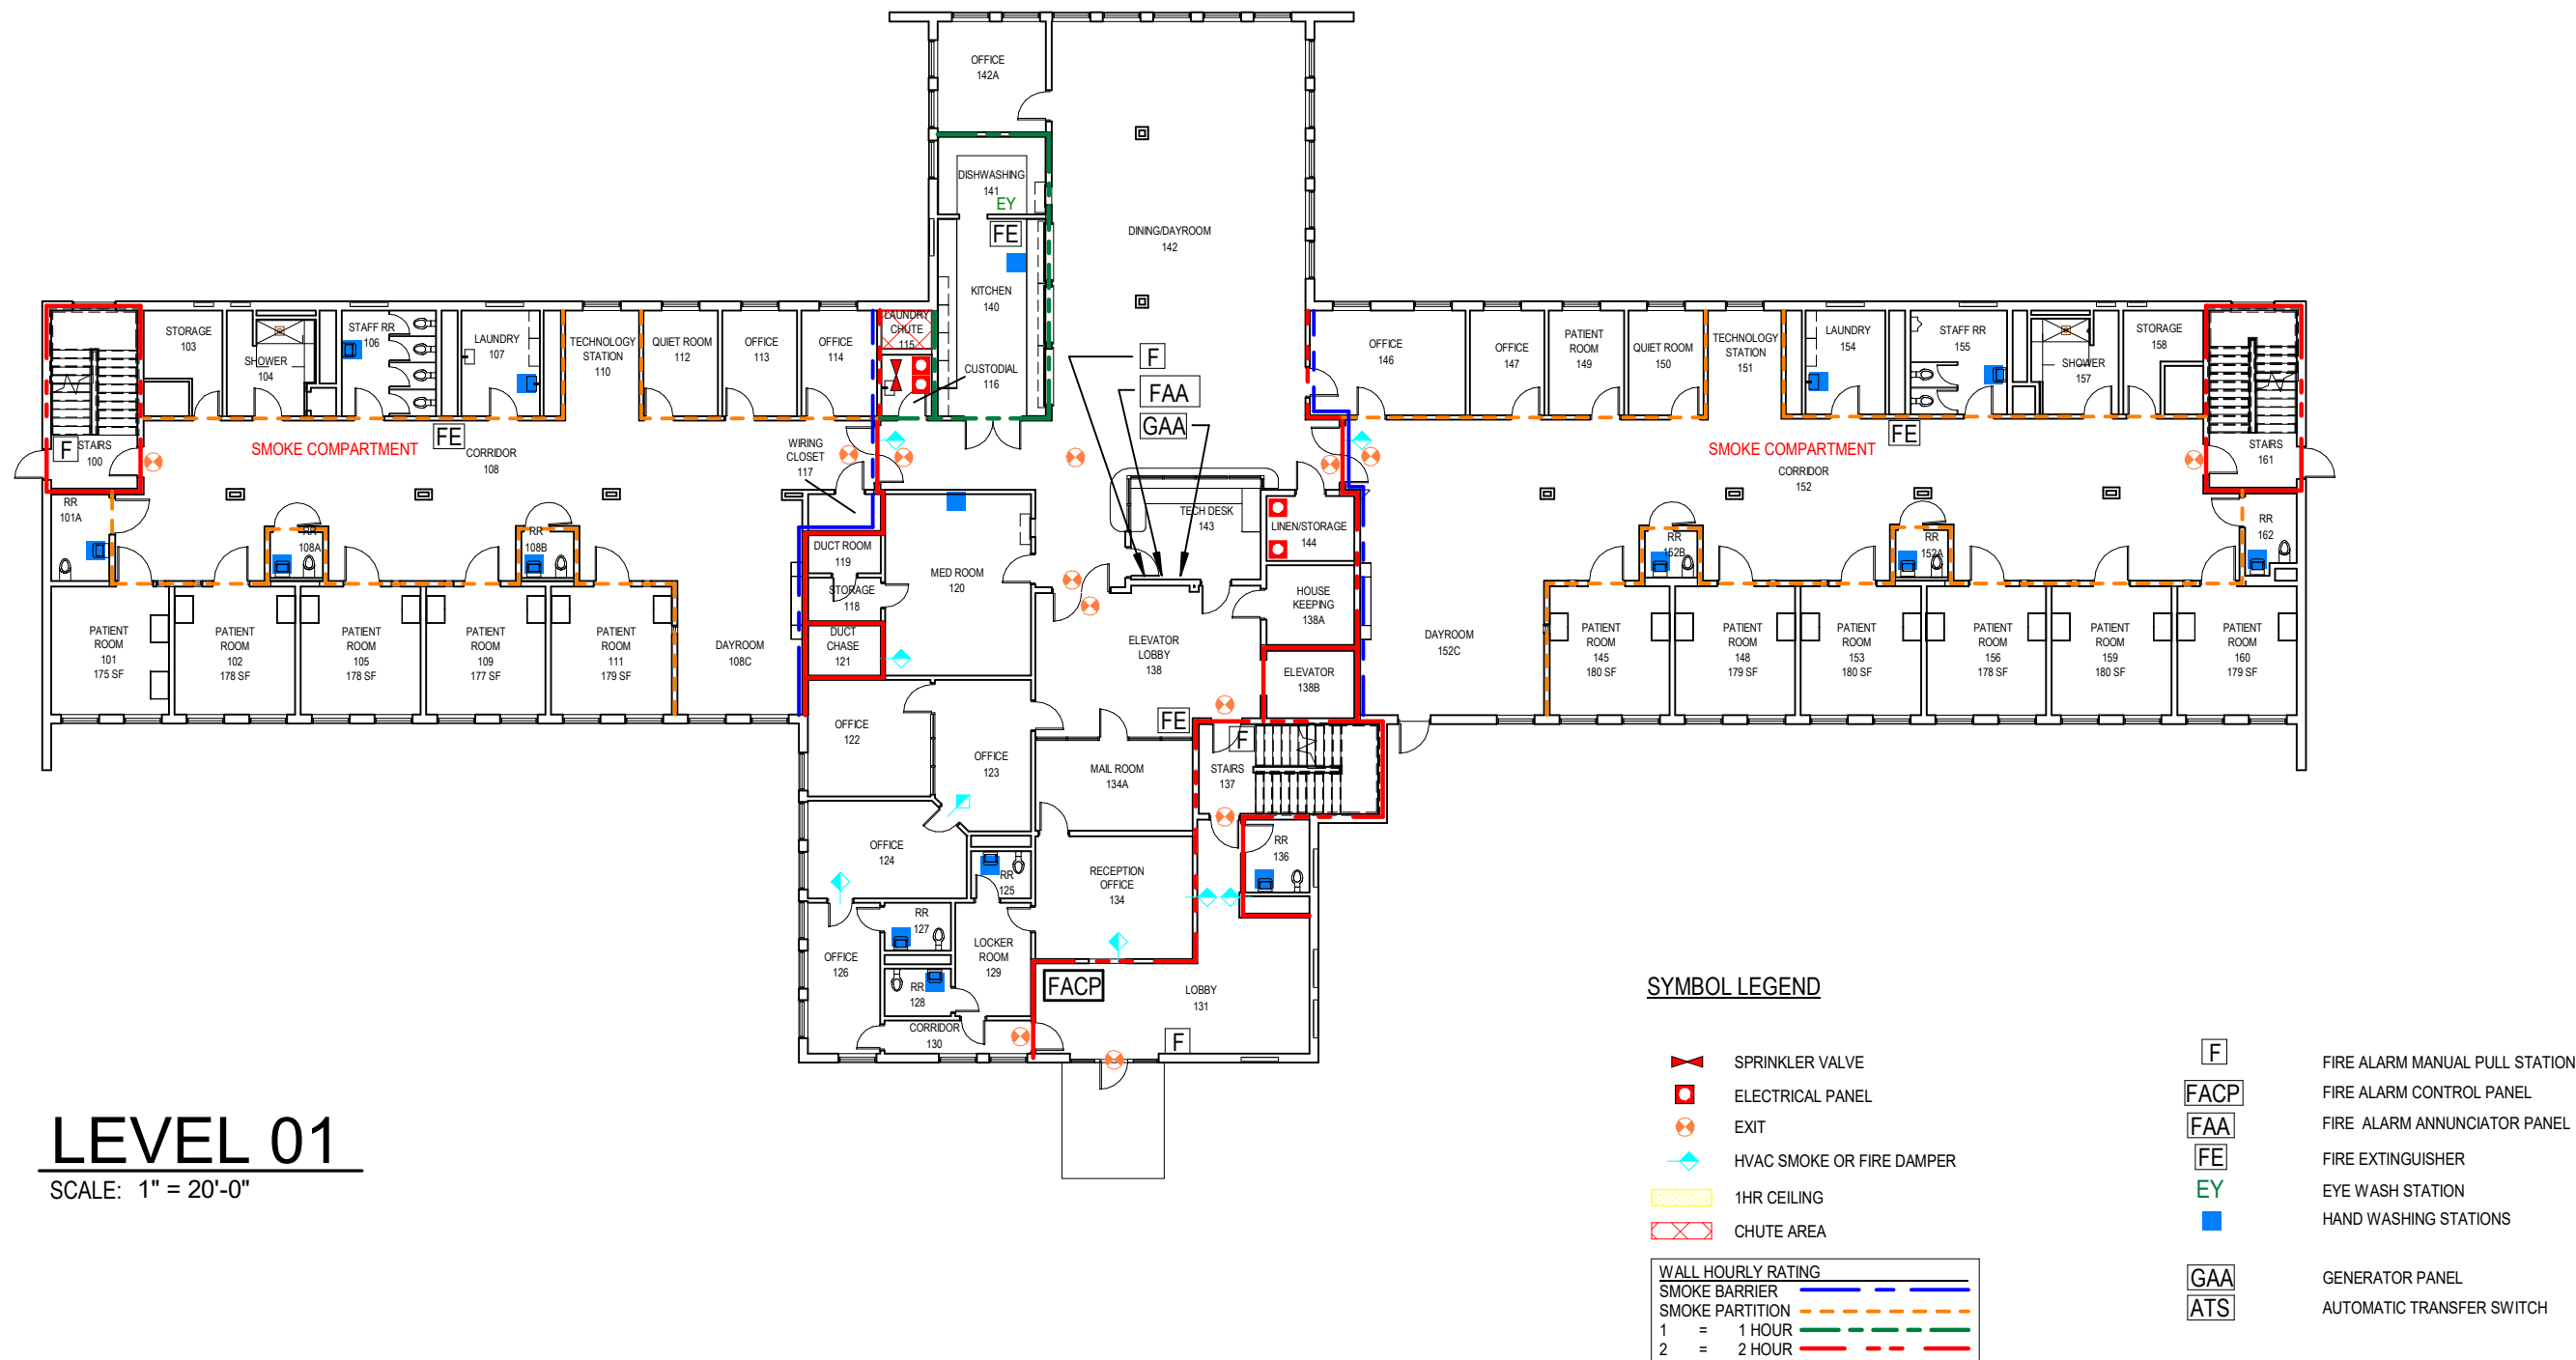

BUILDING #3
LINCOLN REGIONAL CENTER
LINCOLN, NEBRASKA

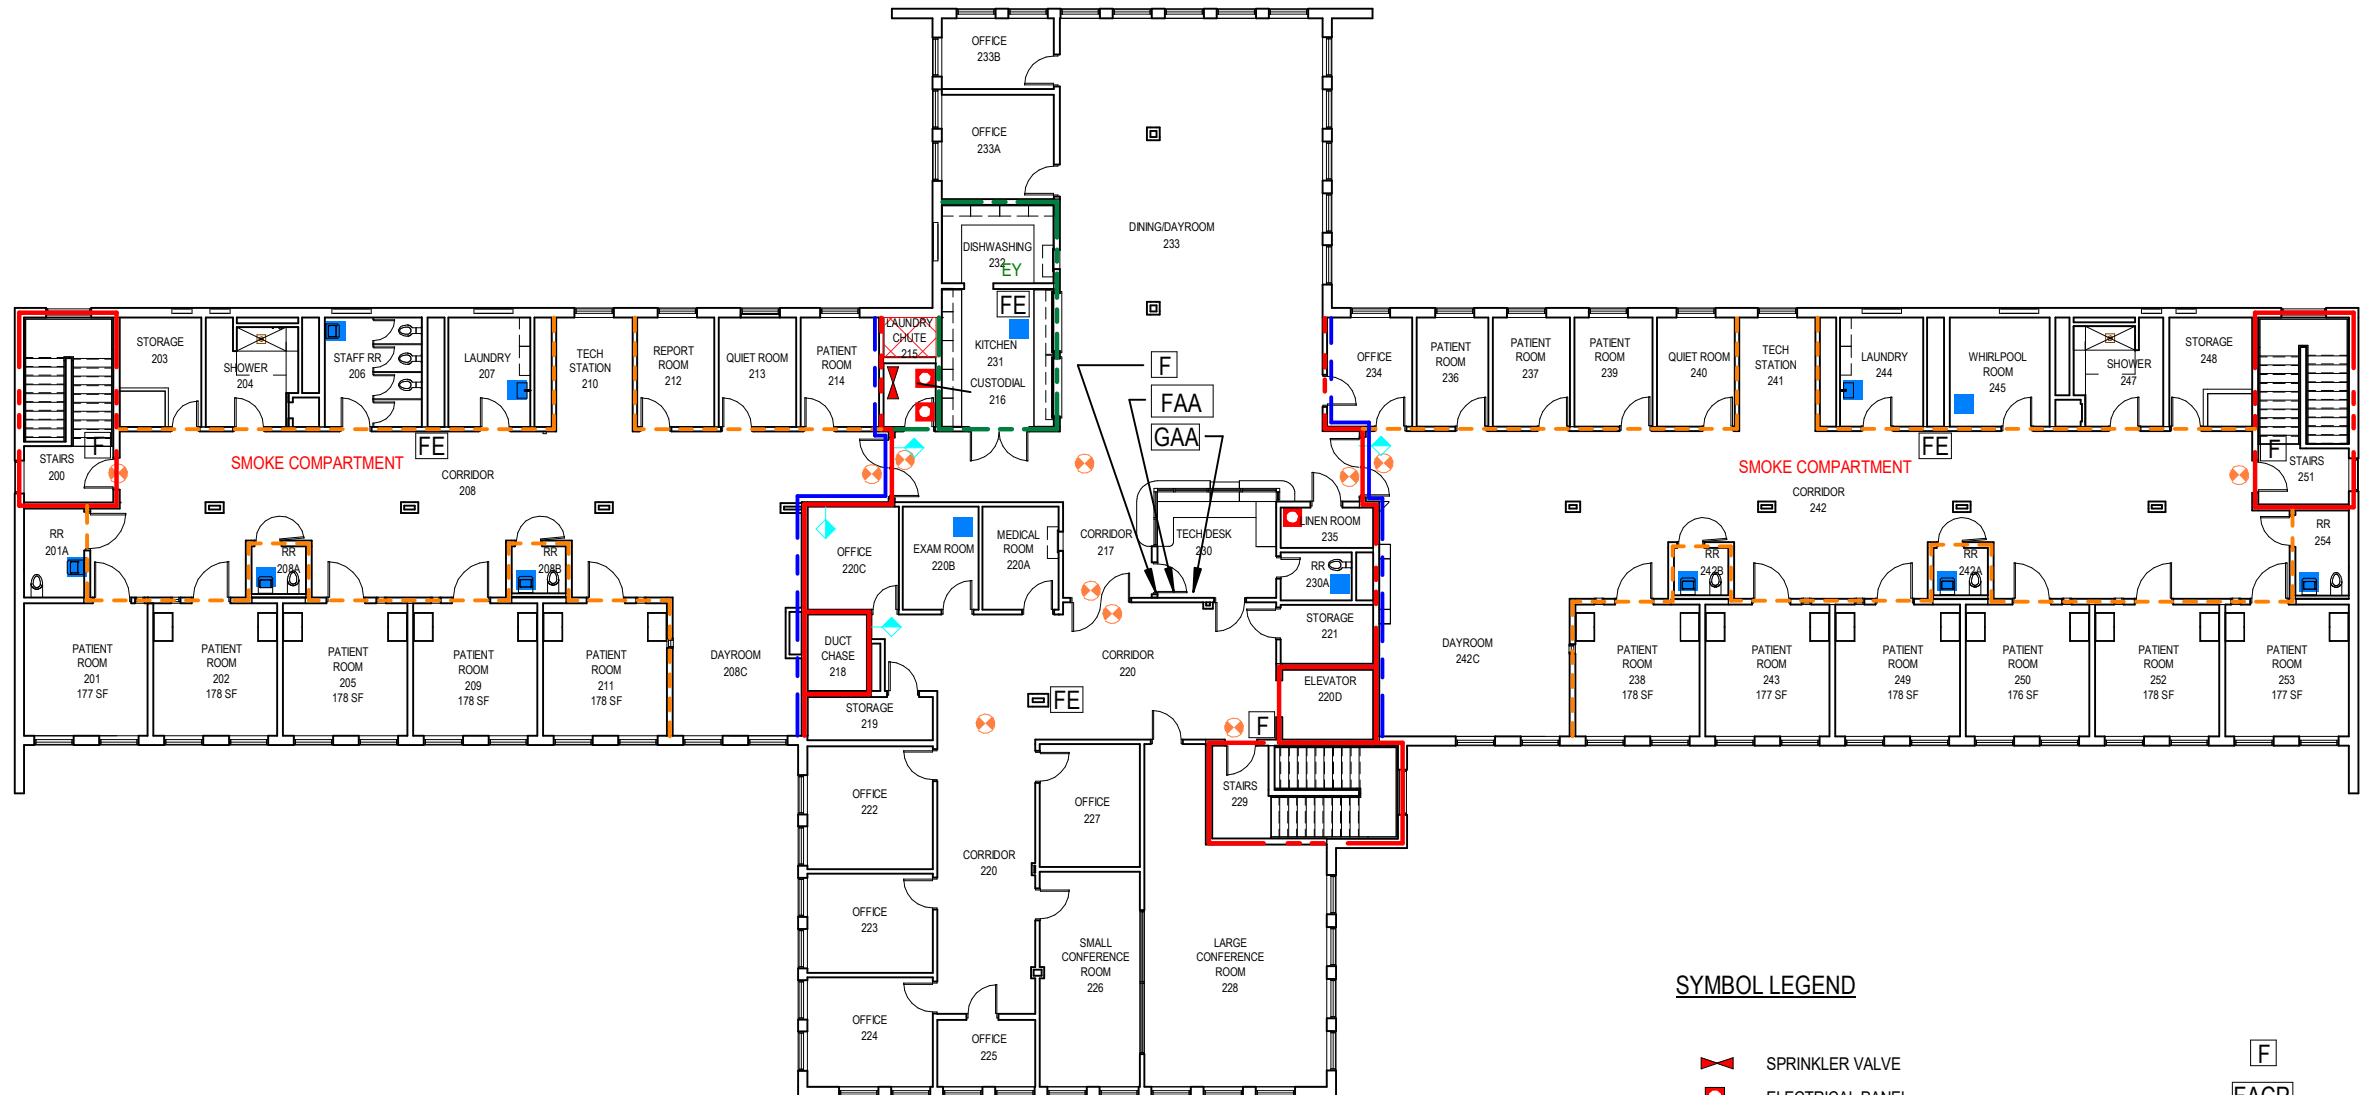

LEVEL 02
SCALE: 1" = 20'-0"

SYMBOL LEGEND

- SPRINKLER VALVE
- ELECTRICAL PANEL
- EXIT
- HVAC SMOKE OR FIRE DAMPER
- 1HR CEILING
- CHUTE AREA

WALL HOURLY RATING	
SMOKE BARRIER	
SMOKE PARTITION	
1 = 1 HOUR	
2 = 2 HOUR	

- FIRE ALARM MANUAL PULL STATION
- FIRE ALARM CONTROL PANEL
- FIRE ALARM ANNUNCIATOR PANEL
- FIRE EXTINGUISHER
- EYE WASH STATION
- HAND WASHING STATIONS
- GENERATOR PANEL
- AUTOMATIC TRANSFER SWITCH

BUILDING #3
LINCOLN REGIONAL CENTER
LINCOLN, NEBRASKA

SYMBOL LEGEND

 SPRINKLER VALVE

 ELECTRICAL PANEL

 EXIT

 HVAC SMOKE OR FIRE DAMPER

 CHUTE AREA

 FIRE ALARM MANUAL PULL STATION

 FIRE ALARM CONTROL PANEL

 FIRE ALARM ANNUNCIATOR PANEL

 FIRE EXTINGUISHER

 EYE WASH STATION

 HAND WASHING STATIONS

 GENERATOR PANEL

 AUTOMATIC TRANSFER SWITCH


WALL HOURLY RATING

SMOKE BARRIER 

SMOKE PARTITION 

1 = 1 HOUR 


2 = 2 HOUR 

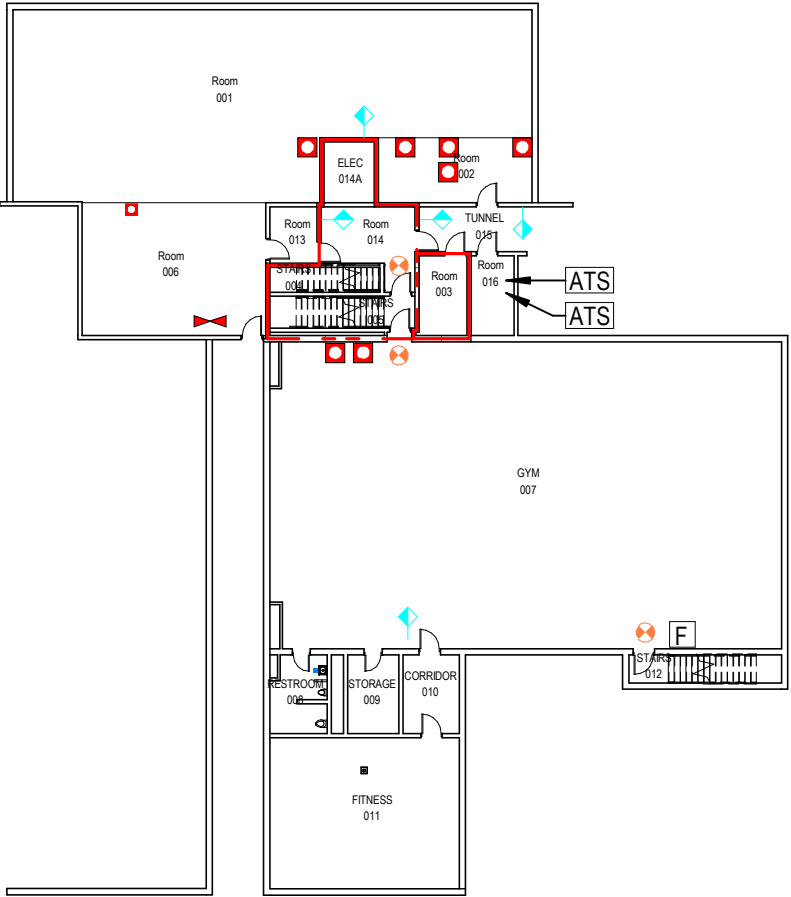

LEVEL 00 - NORTH

SCALE: 1" = 30'-0"

BUILDING #5
LINCOLN REGIONAL CENTER
LINCOLN, NEBRASKA

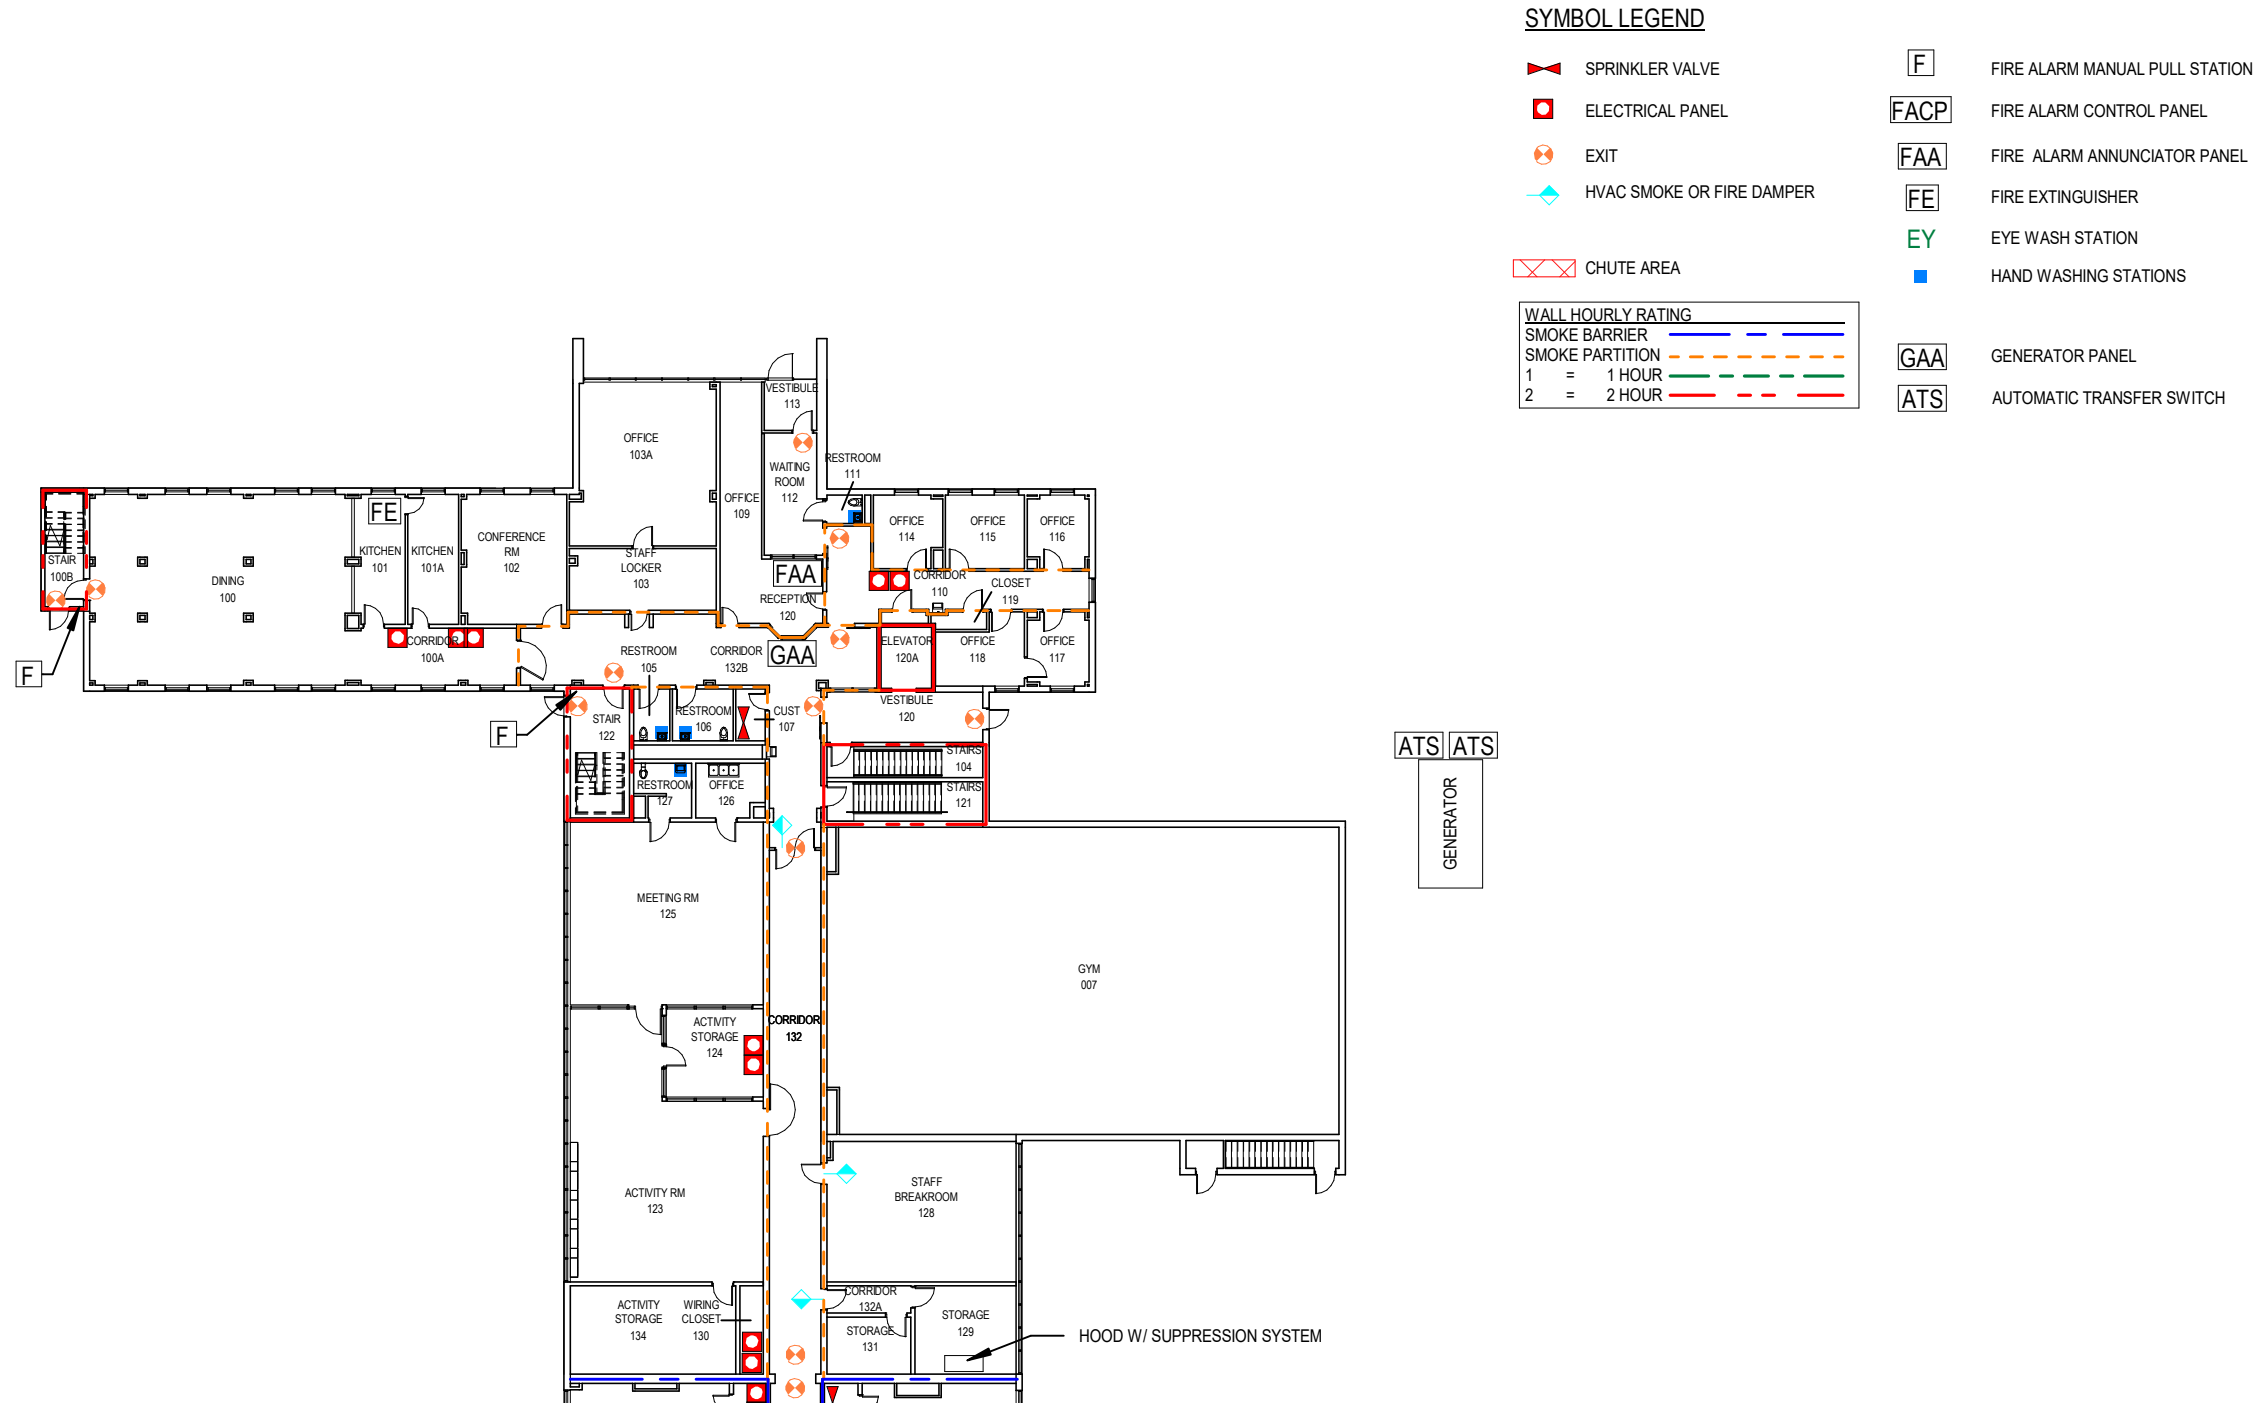

LEVEL 01 - NORTH

SCALE: 1" = 30'-0"

BUILDING #5 LINCOLN REGIONAL CENTER LINCOLN, NEBRASKA

SYMBOL LEGEND

-  SPRINKLER VALVE

 ELECTRICAL PANEL

 EXIT

 HVAC SMOKE OR FIRE DAMPER

 CHUTE AREA
-  FIRE ALARM MANUAL PULL STATION

 FIRE ALARM CONTROL PANEL

 FIRE ALARM ANNUNCIATOR PANEL

 FIRE EXTINGUISHER

 EYE WASH STATION

 HAND WASHING STATIONS

 GENERATOR PANEL


 AUTOMATIC TRANSFER SWITCH
- WALL HOURLY RATING

SMOKE BARRIER ————

SMOKE PARTITION - - - - -

1 = 1 HOUR ————


2 = 2 HOUR - - - - -

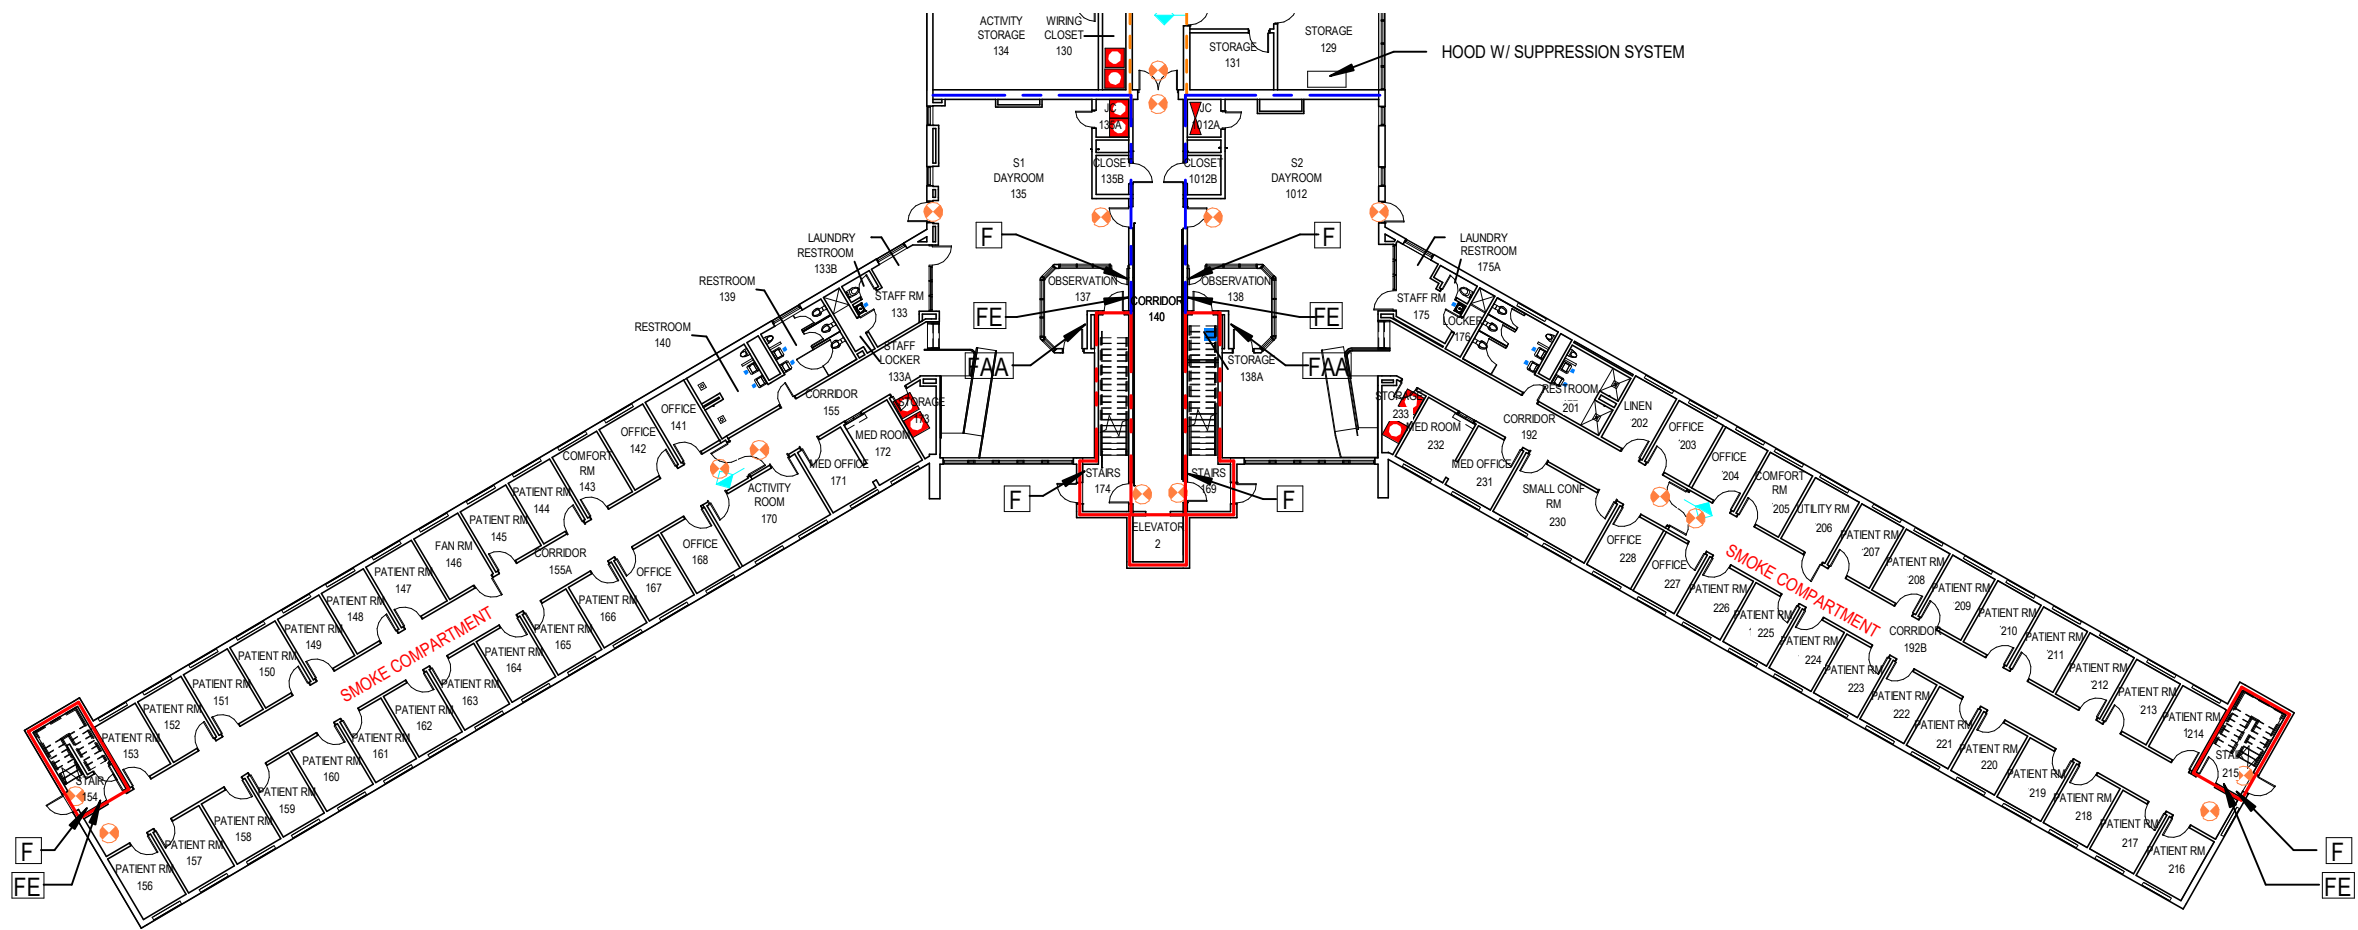

LEVEL 01 - SOUTH

SCALE: 1" = 30'-0"

BUILDING #5
LINCOLN REGIONAL CENTER
LINCOLN, NEBRASKA

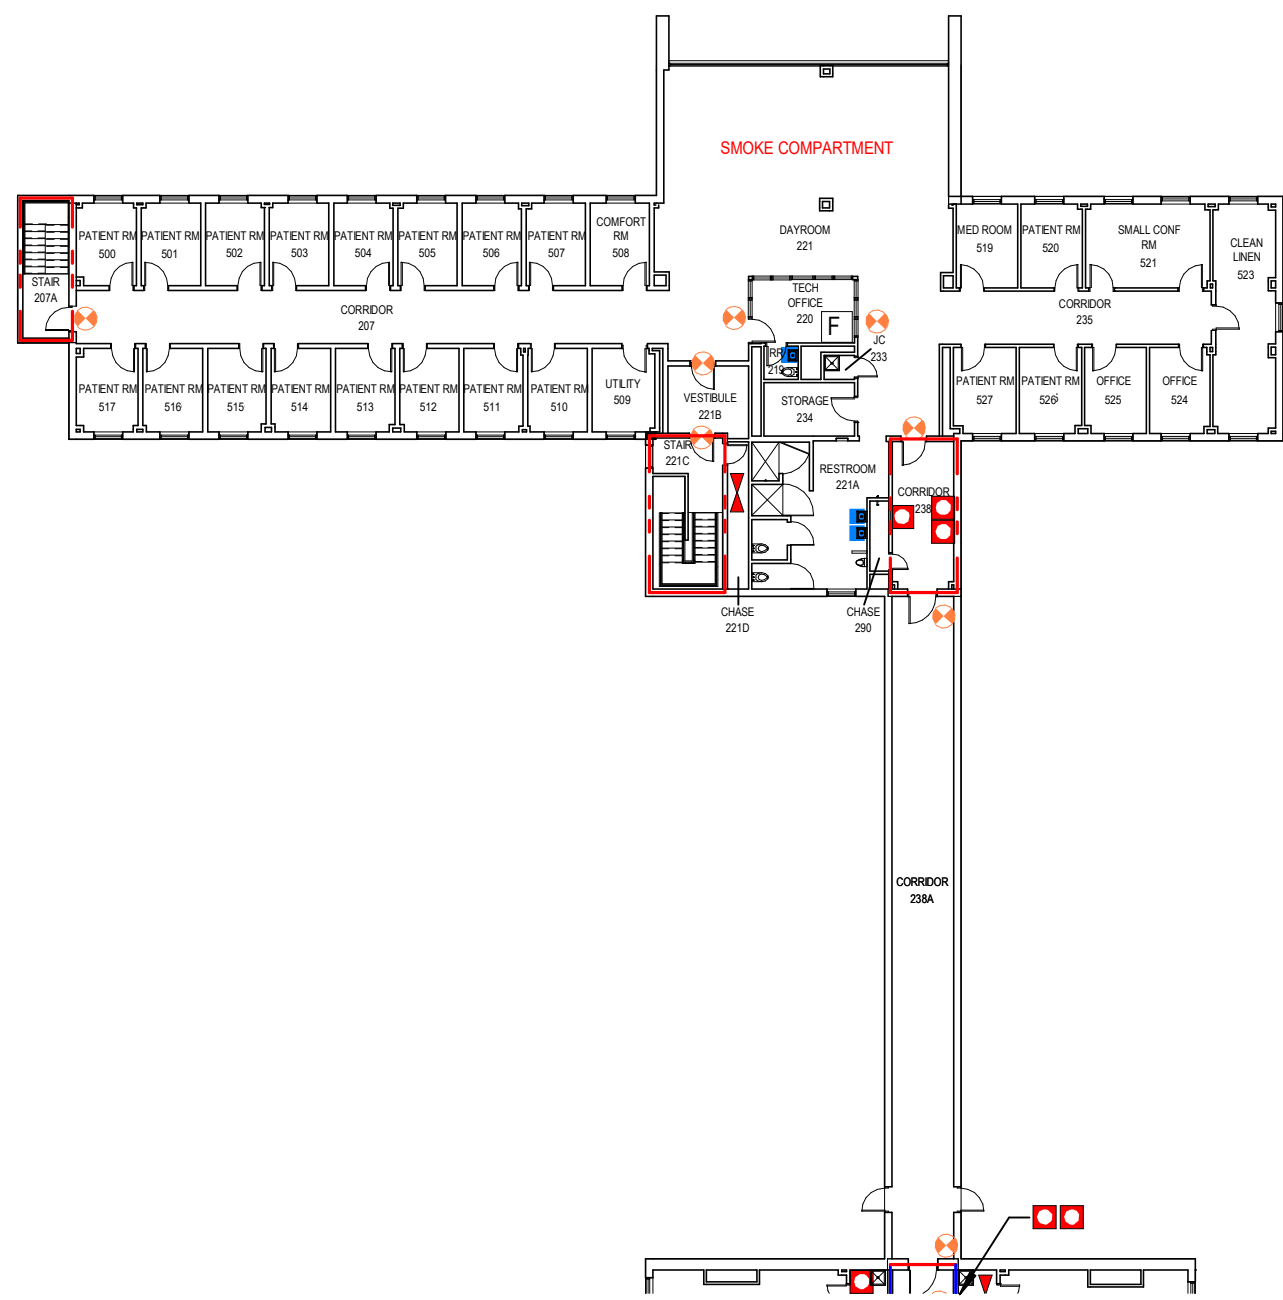

SYMBOL LEGEND

- SPRINKLER VALVE
- ELECTRICAL PANEL
- EXIT
- HVAC SMOKE OR FIRE DAMPER
- CHUTE AREA
- FIRE ALARM MANUAL PULL STATION
- FIRE ALARM CONTROL PANEL
- FIRE ALARM ANNUNCIATOR PANEL
- FIRE EXTINGUISHER
- EYE WASH STATION
- HAND WASHING STATIONS
- GENERATOR PANEL
- AUTOMATIC TRANSFER SWITCH

WALL HOURLY RATING	
SMOKE BARRIER	---
SMOKE PARTITION	---
1 = 1 HOUR	---
2 = 2 HOUR	---

LEVEL 02 - NORTH

SCALE: 1 : 300

BUILDING #5
LINCOLN REGIONAL CENTER
LINCOLN, NEBRASKA

SYMBOL LEGEND

-  SPRINKLER VALVE

 ELECTRICAL PANEL

 EXIT

 HVAC SMOKE OR FIRE DAMPER

 CHUTE AREA
-  FIRE ALARM MANUAL PULL STATION

 FIRE ALARM CONTROL PANEL

 FIRE ALARM ANNUNCIATOR PANEL

 FIRE EXTINGUISHER

 EYE WASH STATION

 HAND WASHING STATIONS


 GENERATOR PANEL

 AUTOMATIC TRANSFER SWITCH
-  SMOKE BARRIER

 SMOKE PARTITION

 1 = 1 HOUR


 2 = 2 HOUR

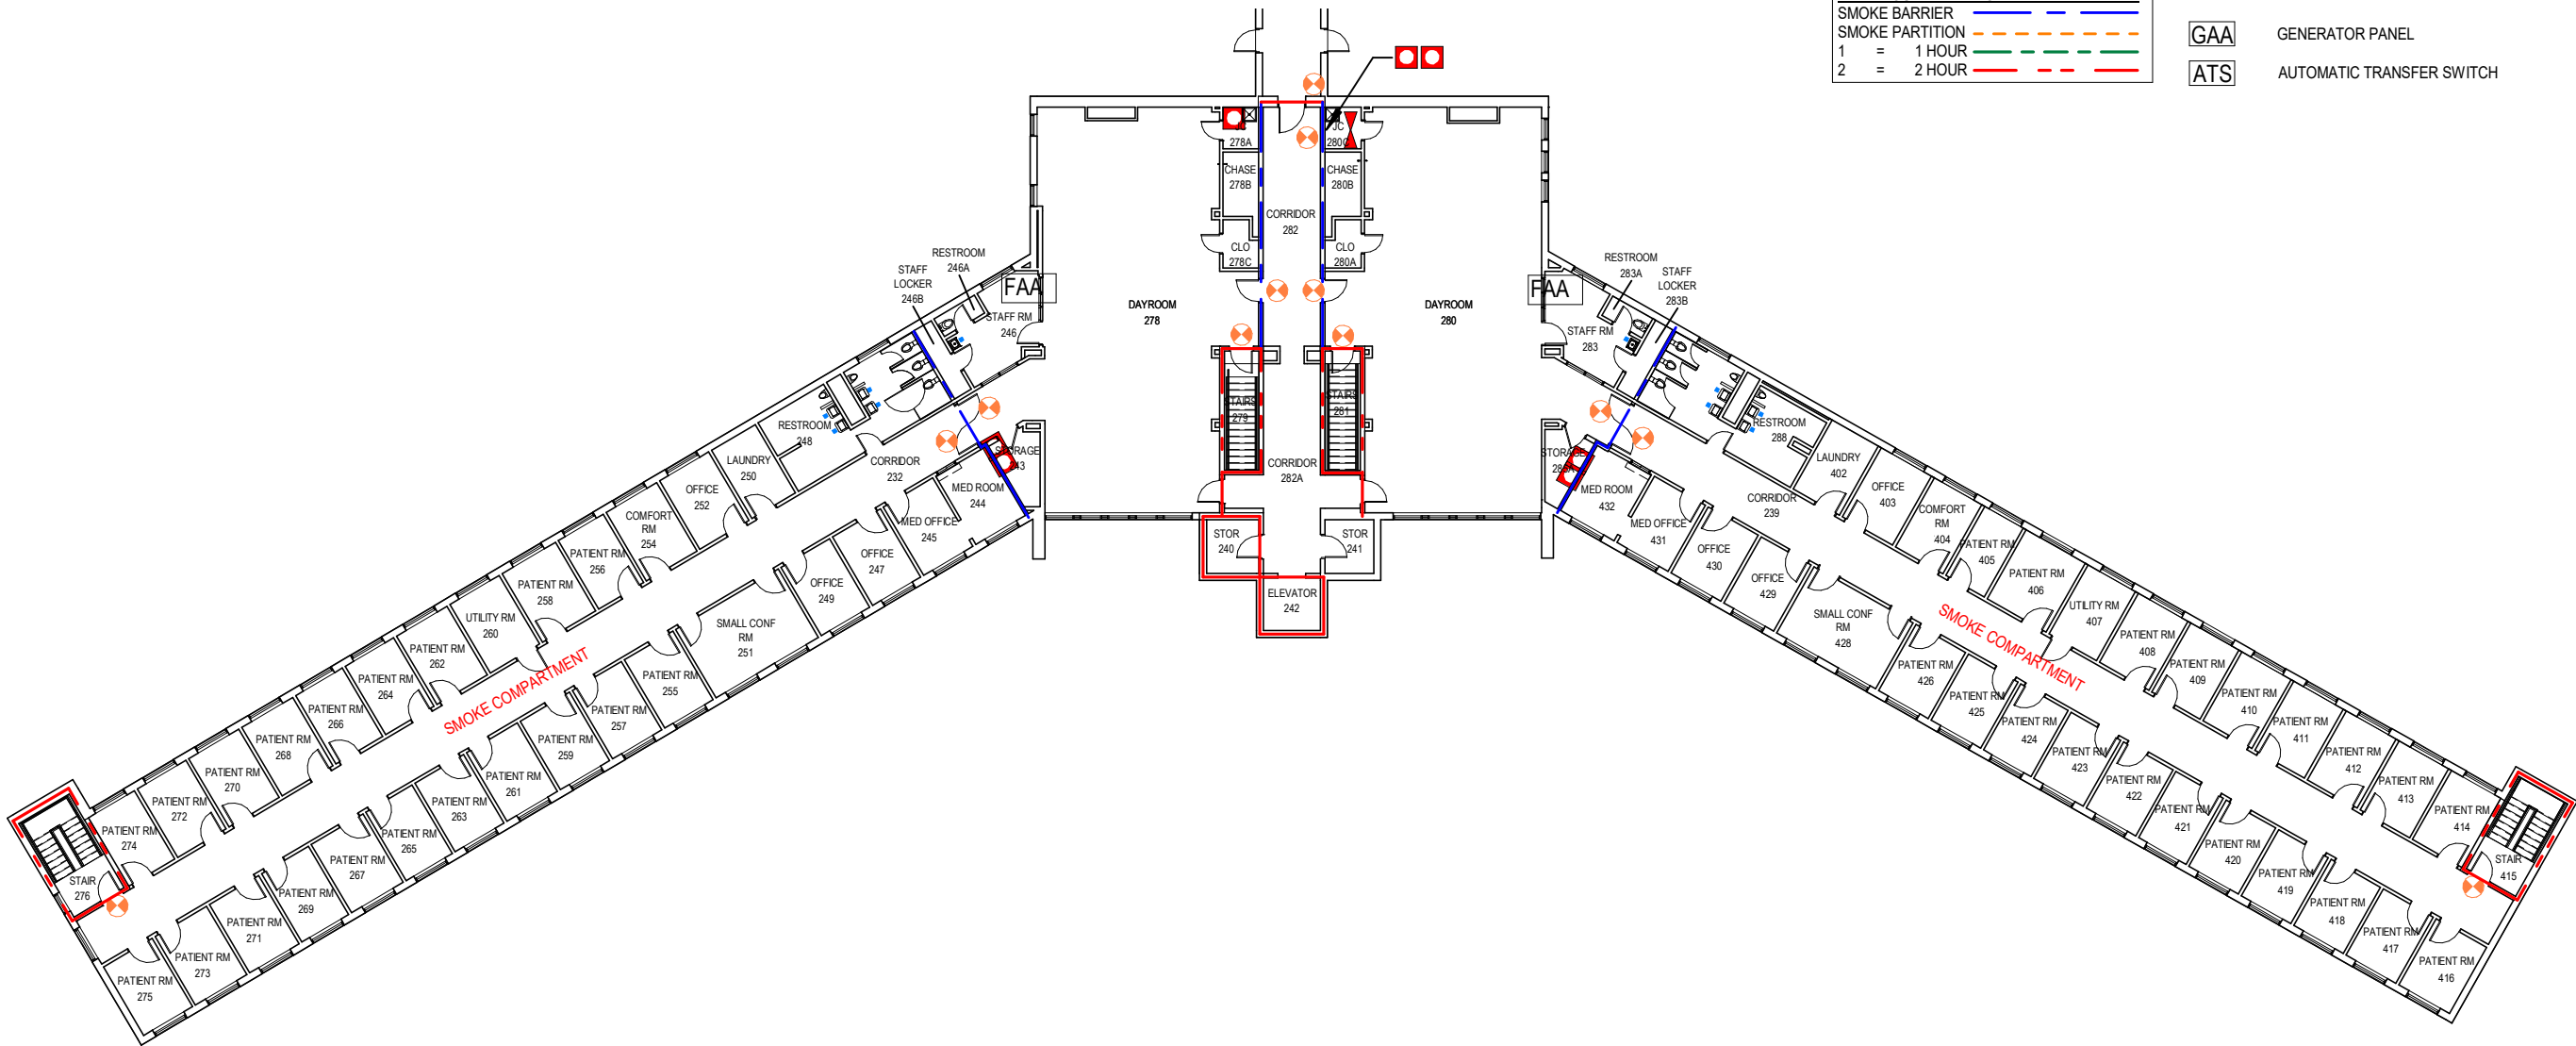

LEVEL 02 - SOUTH

SCALE: 1 : 300

BUILDING #5
LINCOLN REGIONAL CENTER
LINCOLN, NEBRASKA

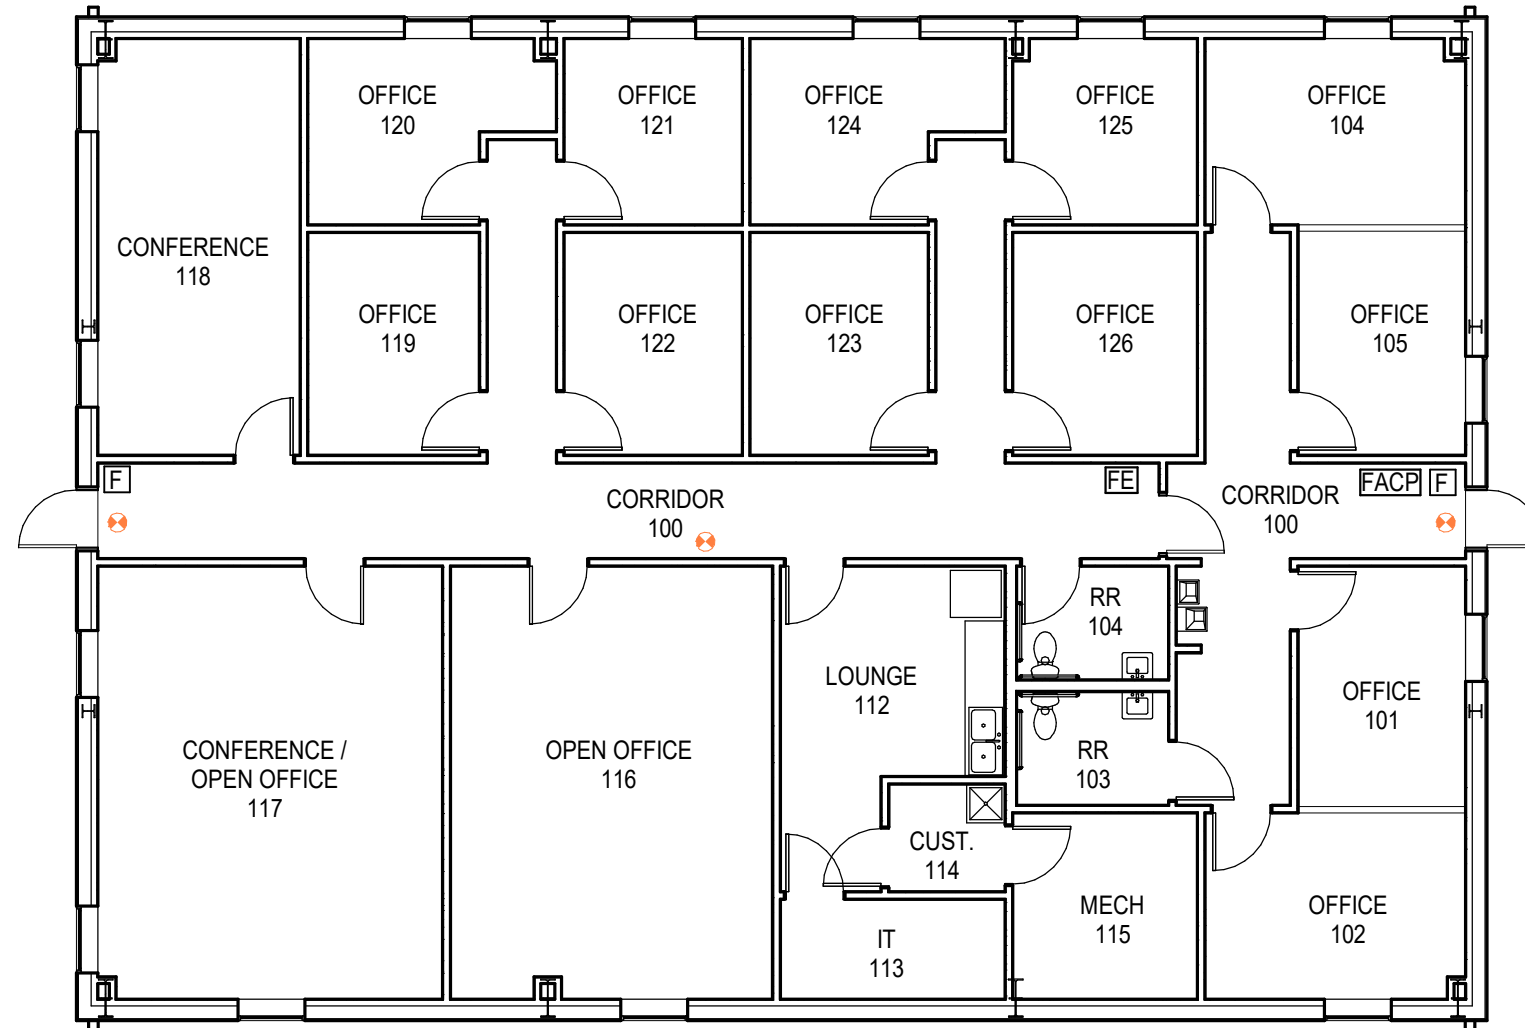

LEVEL 01

SCALE: 1" = 10'-0"

SYMBOL LEGEND



EXIT




FIRE ALARM MANUAL PULL STATION



FIRE ALARM CONTROL PANEL

** THIS STRUCTURE IS NOT EQUIPPED WITH A
FIRE SUPPRESSION SYSTEM

BUILDING #5A
LINCOLN REGIONAL CENTER
LINCOLN, NEBRASKA

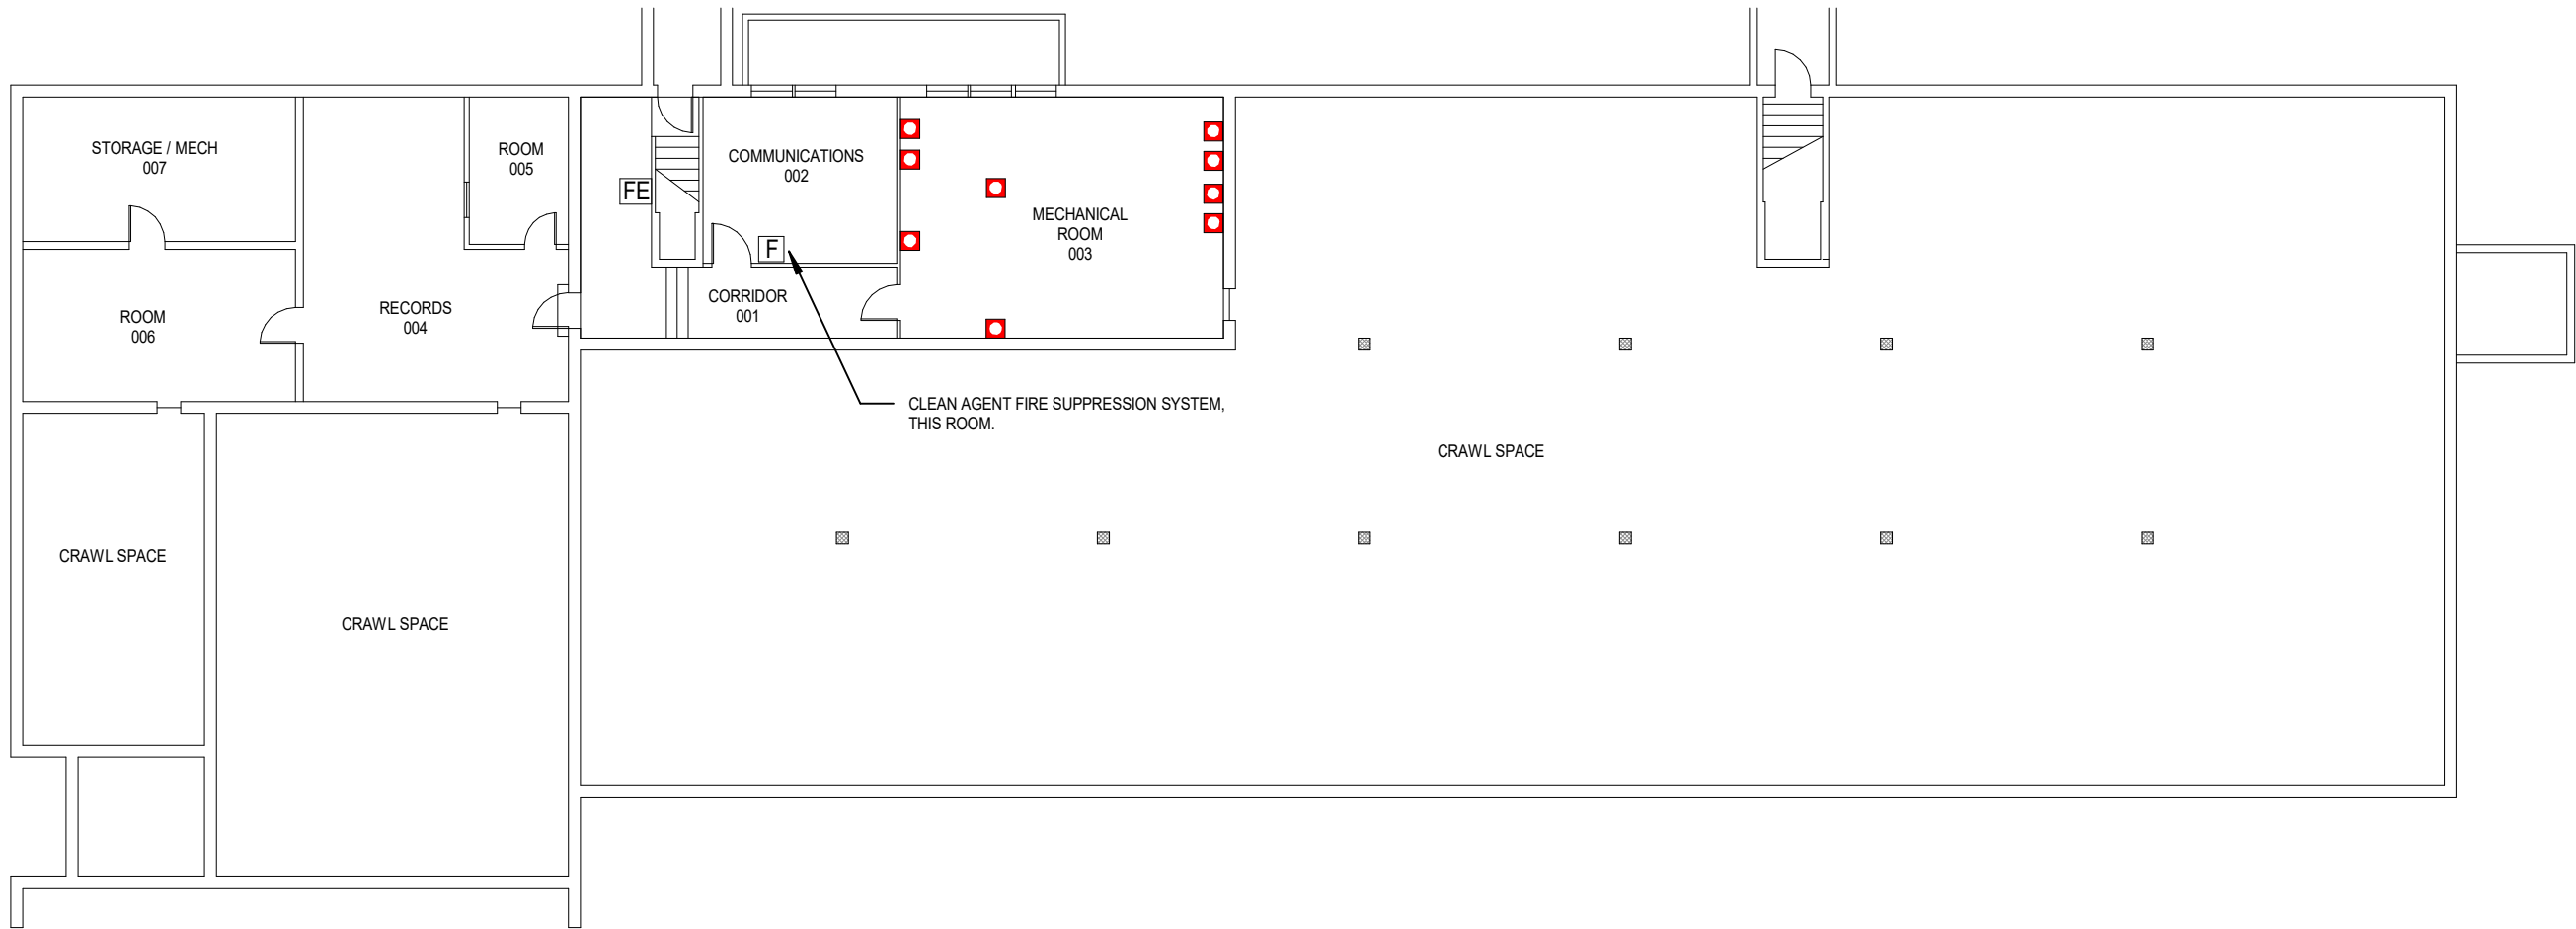

LEVEL 00

SCALE: 1/16" = 1'-0"


SYMBOL LEGEND

- ELECTRICAL PANEL
- EXIT
- HVAC SMOKE OR FIRE DAMPER

**THIS STRUCTURE IS NOT EQUIPED WITH A FIRE SUPPRESSION SYSTEM EXCEPT WHERE NOTED.

- FIRE ALARM MANUAL PULL STATION
- FIRE ALARM CONTROL PANEL
- FIRE ALARM ANNUNCIATOR PANEL
- FIRE EXTINGUISHER

BUILDING #9
LINCOLN REGIONAL CENTER
LINCOLN, NEBRASKA

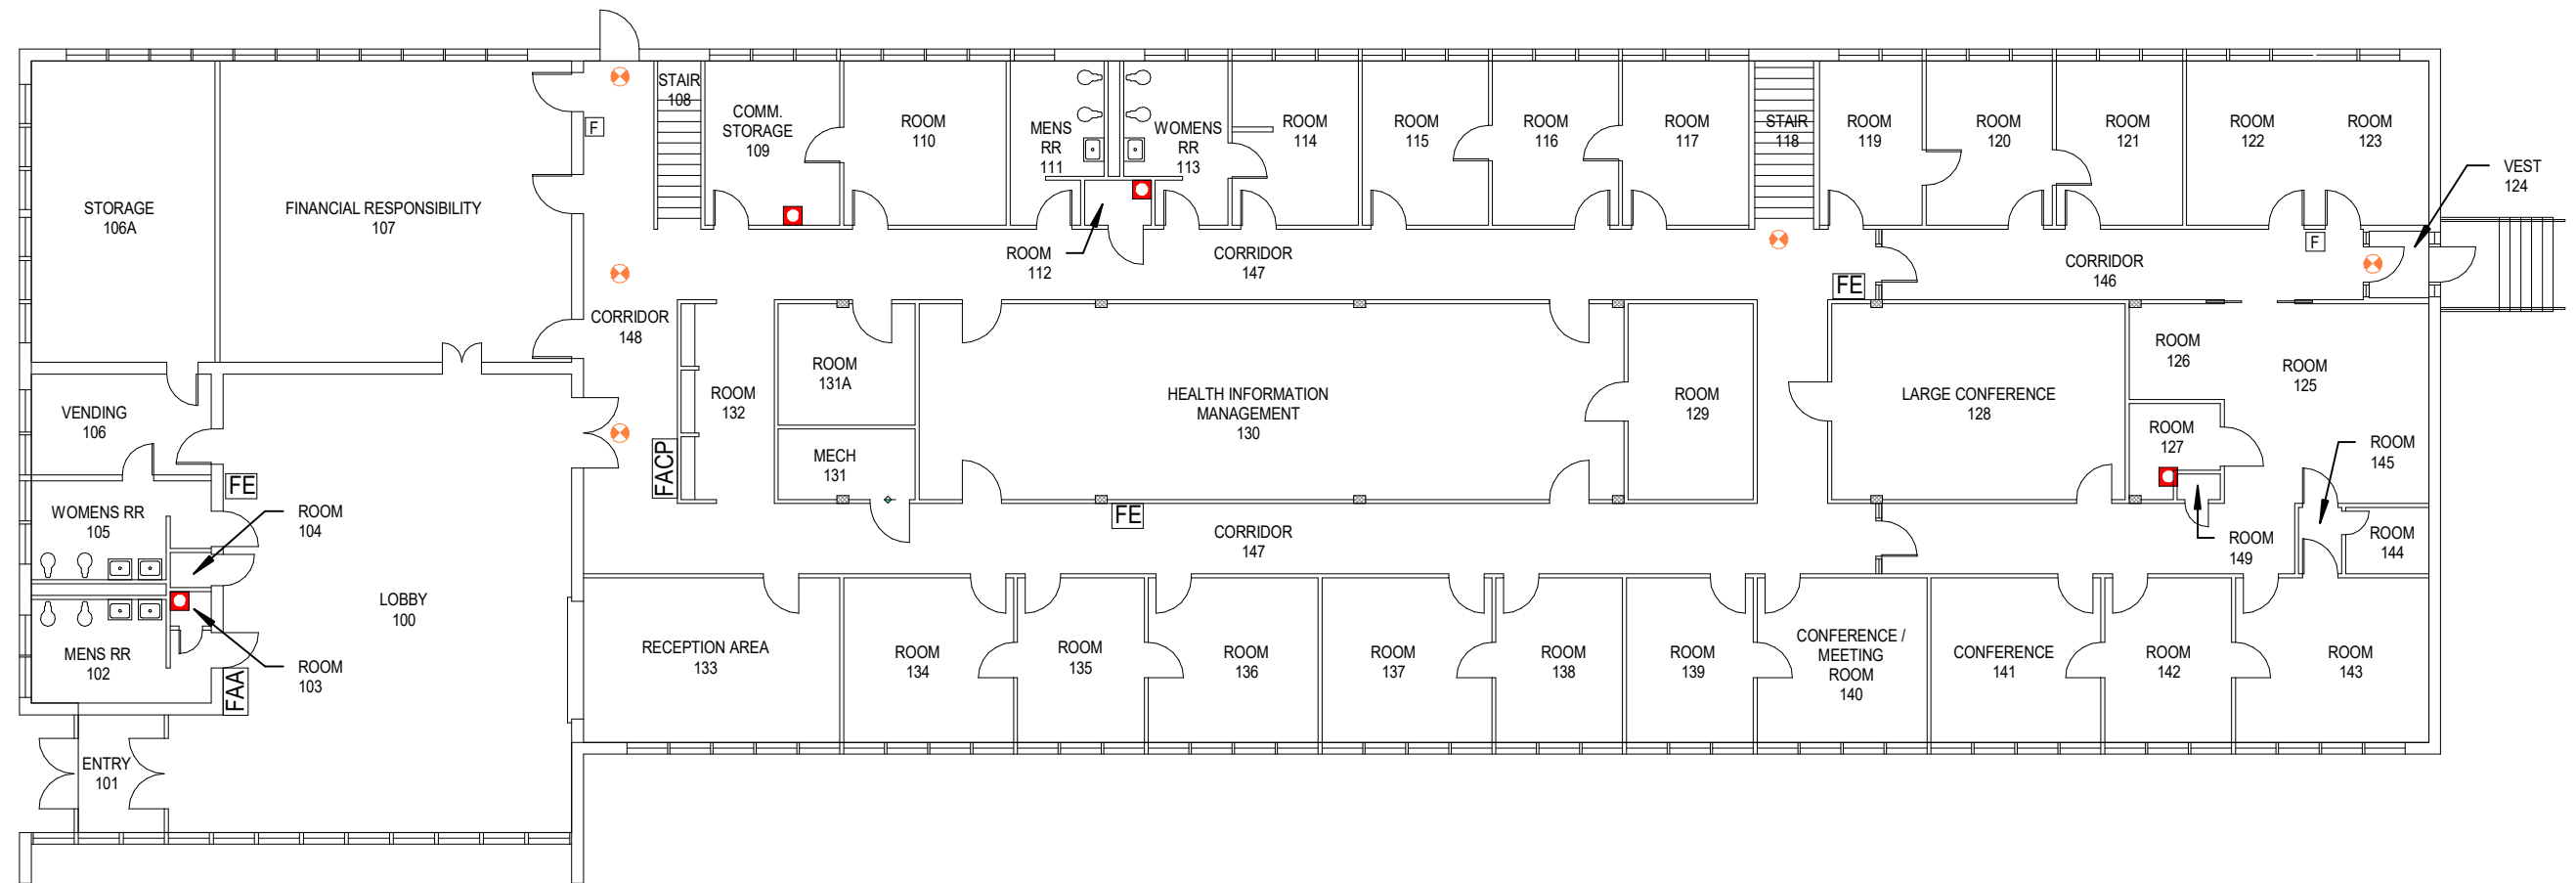

LEVEL 01

SCALE: 1/16" = 1'-0"


SYMBOL LEGEND

-  ELECTRICAL PANEL
-  EXIT
-  HVAC SMOKE OR FIRE DAMPER

**THIS STRUCTURE IS NOT EQUIPPED WITH A FIRE SUPPRESSION SYSTEM EXCEPT WHERE NOTED.

-  FIRE ALARM MANUAL PULL STATION
-  FIRE ALARM CONTROL PANEL
-  FIRE ALARM ANNUNCIATOR PANEL
-  FIRE EXTINGUISHER

BUILDING #9 LINCOLN REGIONAL CENTER LINCOLN, NEBRASKA



LEVEL 02

SCALE: 1/16" = 1'-0"


SYMBOL LEGEND

-  ELECTRICAL PANEL
-  EXIT
-  HVAC SMOKE OR FIRE DAMPER

**THIS STRUCTURE IS NOT EQUIPED WITH A FIRE SUPPRESSION SYSTEM EXCEPT WHERE NOTED.


-  FIRE ALARM MANUAL PULL STATION
-  FIRE ALARM CONTROL PANEL
-  FIRE ALARM ANNUNCIATOR PANEL
-  FIRE EXTINGUISHER

BUILDING #9 LINCOLN REGIONAL CENTER LINCOLN, NEBRASKA

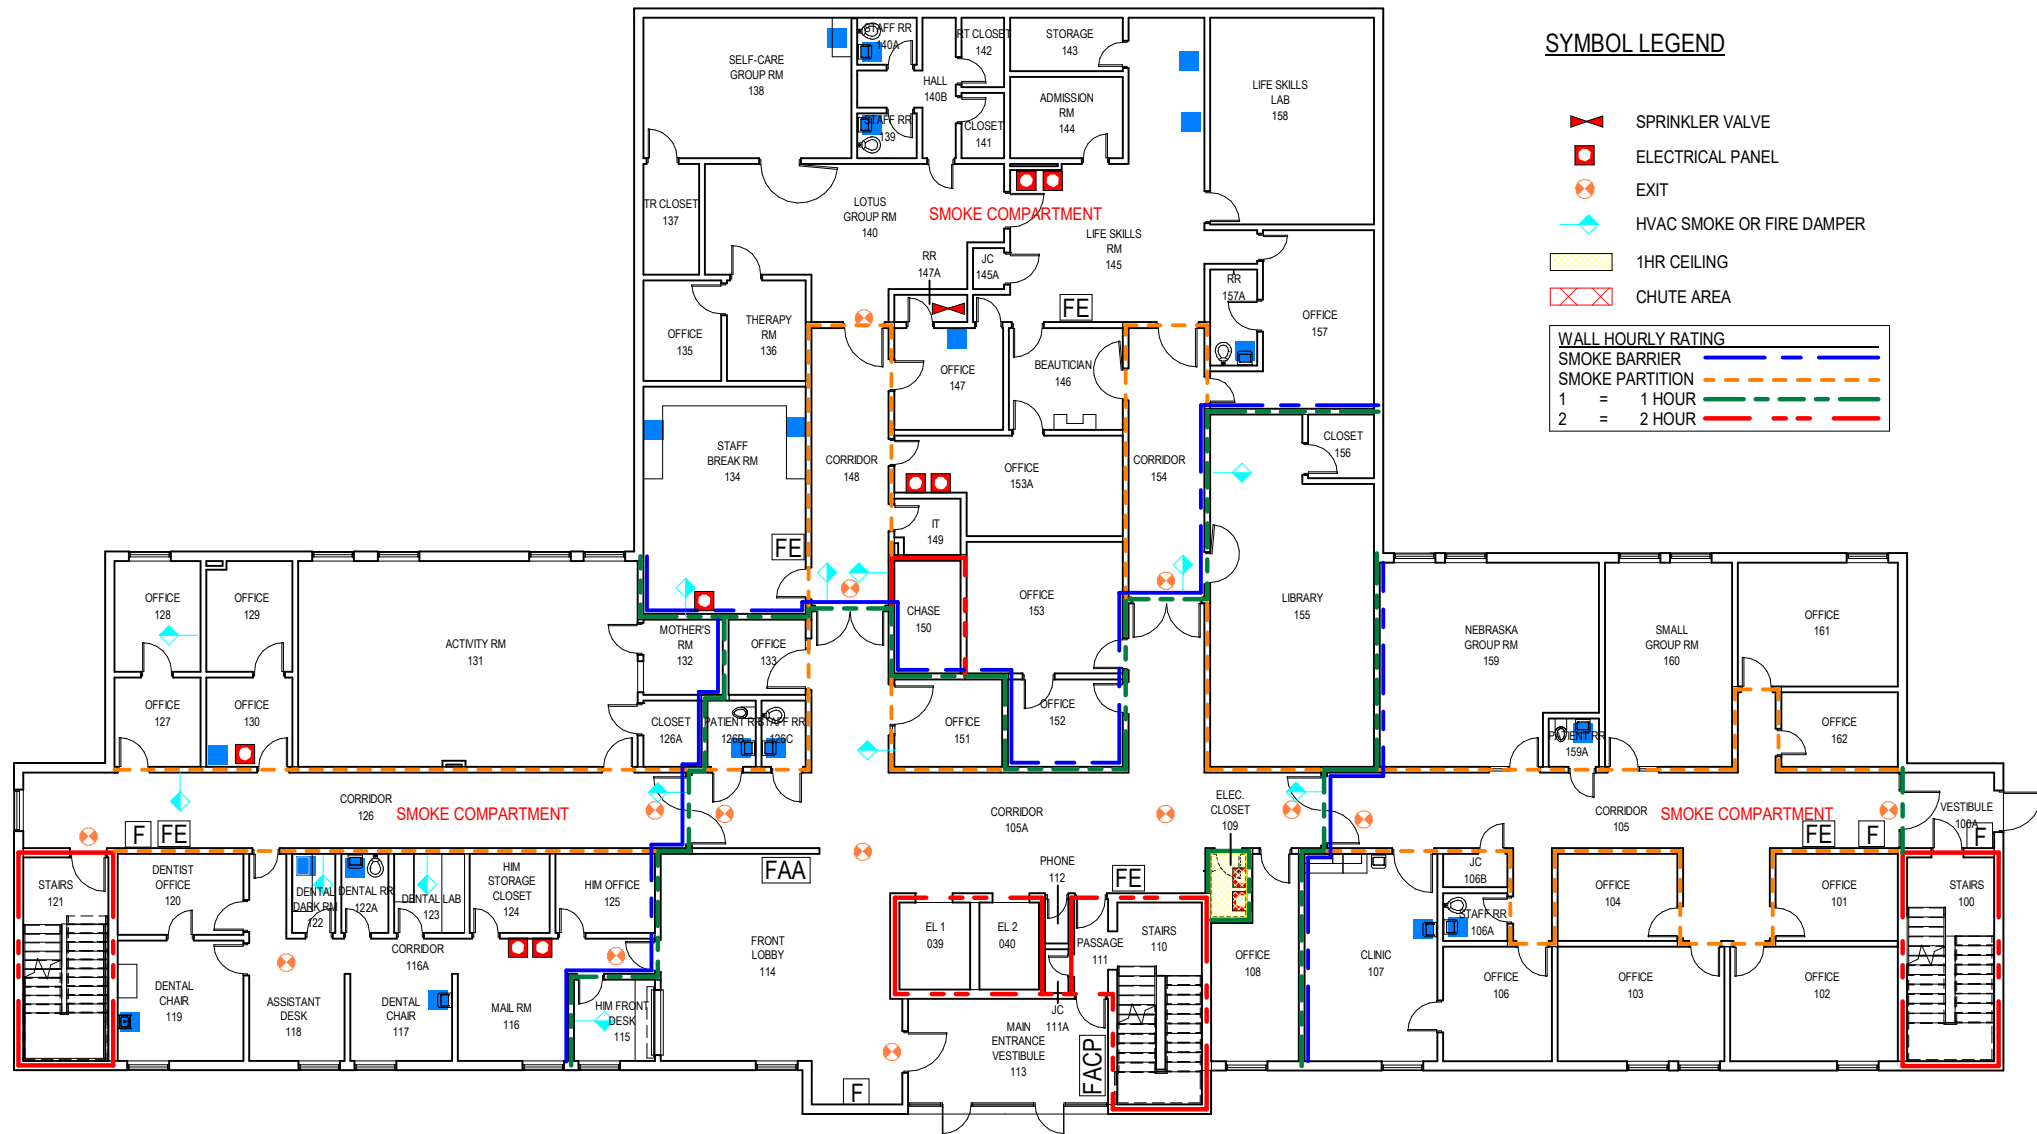


LEVEL 01
SCALE: 1" = 20'-0"

BUILDING #10
LINCOLN REGIONAL CENTER
LINCOLN, NEBRASKA

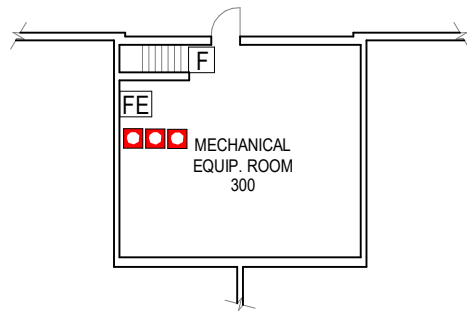

LEVEL 03

SCALE: 1" = 20'-0"

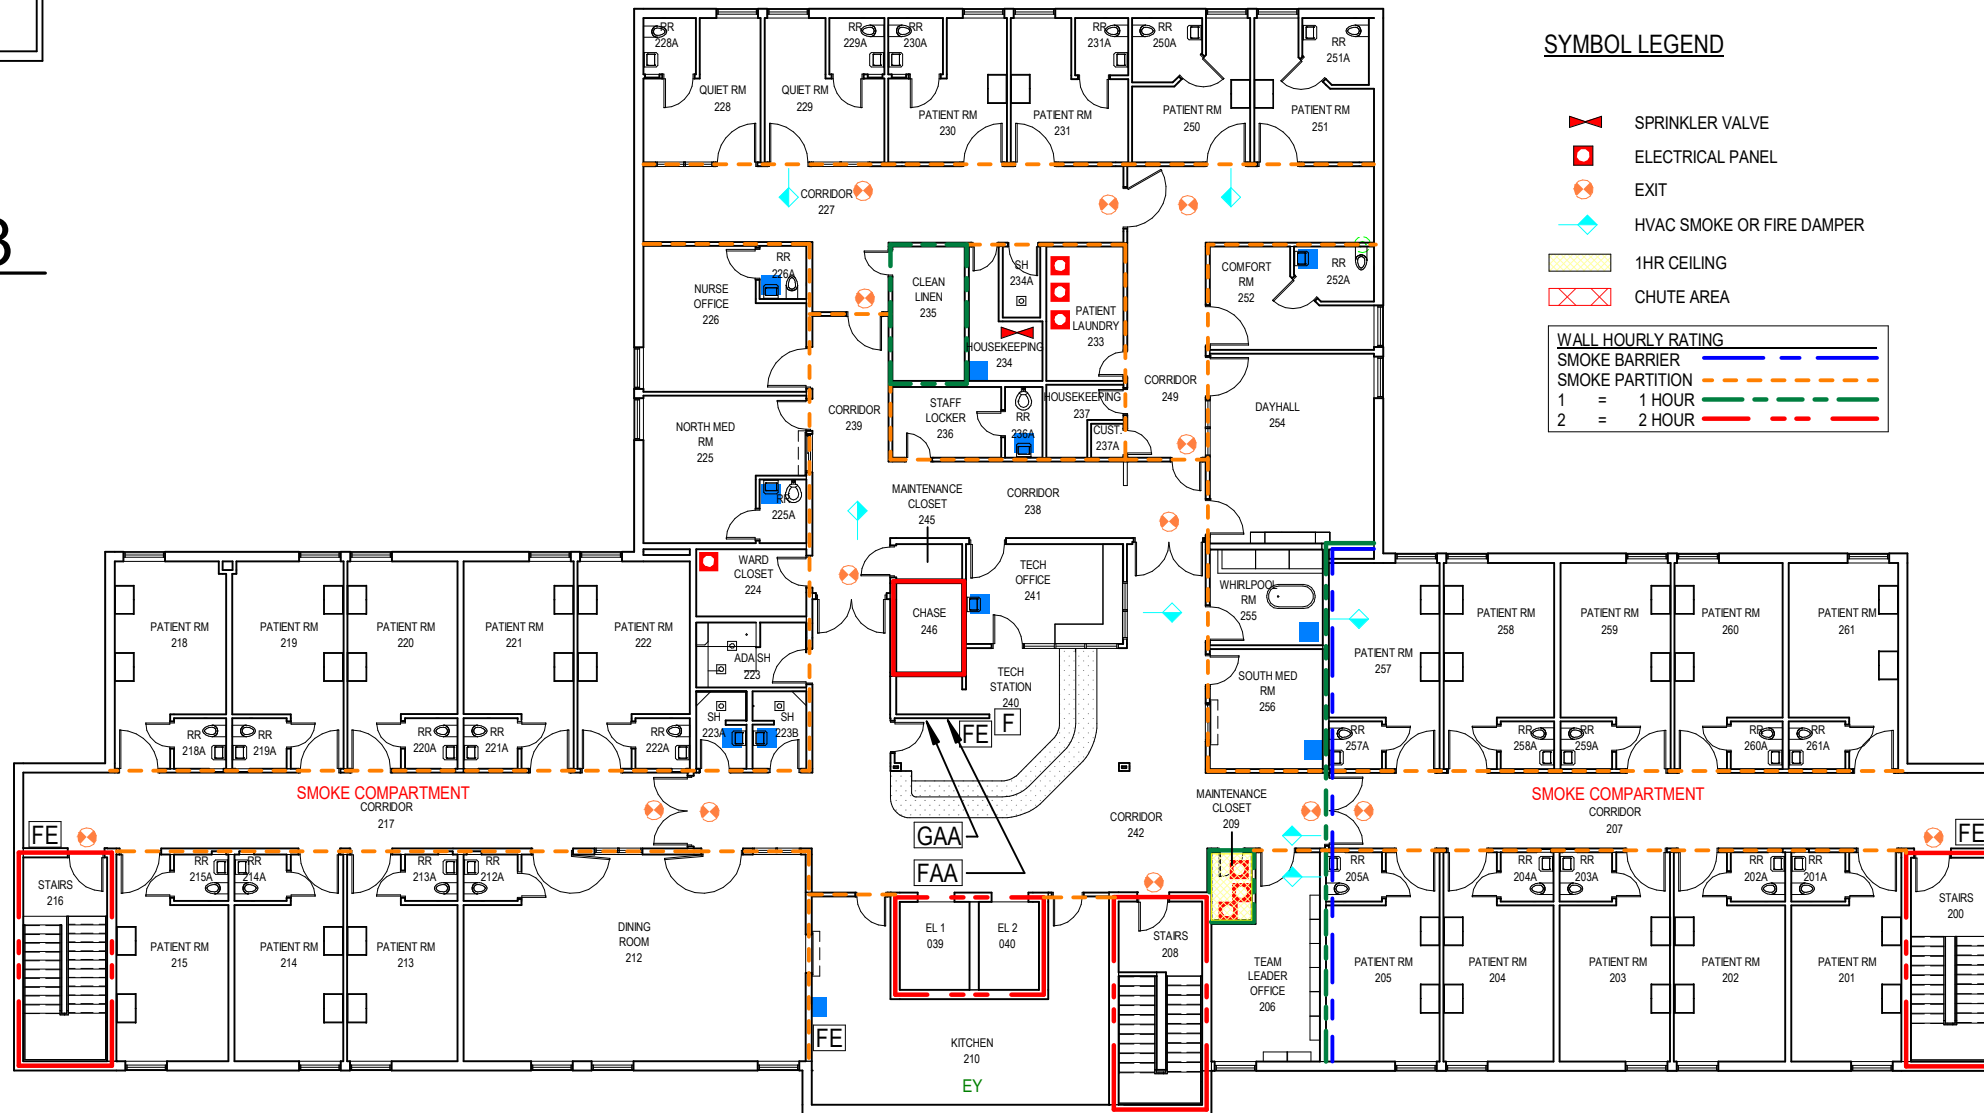

SYMBOL LEGEND

- SPRINKLER VALVE
- ELECTRICAL PANEL
- EXIT
- HVAC SMOKE OR FIRE DAMPER
- 1HR CEILING
- CHUTE AREA


WALL HOURLY RATING	
SMOKE BARRIER	
SMOKE PARTITION	
1 = 1 HOUR	
2 = 2 HOUR	

- FIRE ALARM MANUAL PULL STATION
- FIRE ALARM CONTROL PANEL
- FIRE ALARM ANNUNCIATOR PANEL
- FIRE EXTINGUISHER
- EYE WASH STATION
- HAND WASHING STATIONS
- GENERATOR PANEL
- AUTOMATIC TRANSFER SWITCH

LEVEL 02


SCALE: 1" = 20'-0"

BUILDING #10 LINCOLN REGIONAL CENTER LINCOLN, NEBRASKA

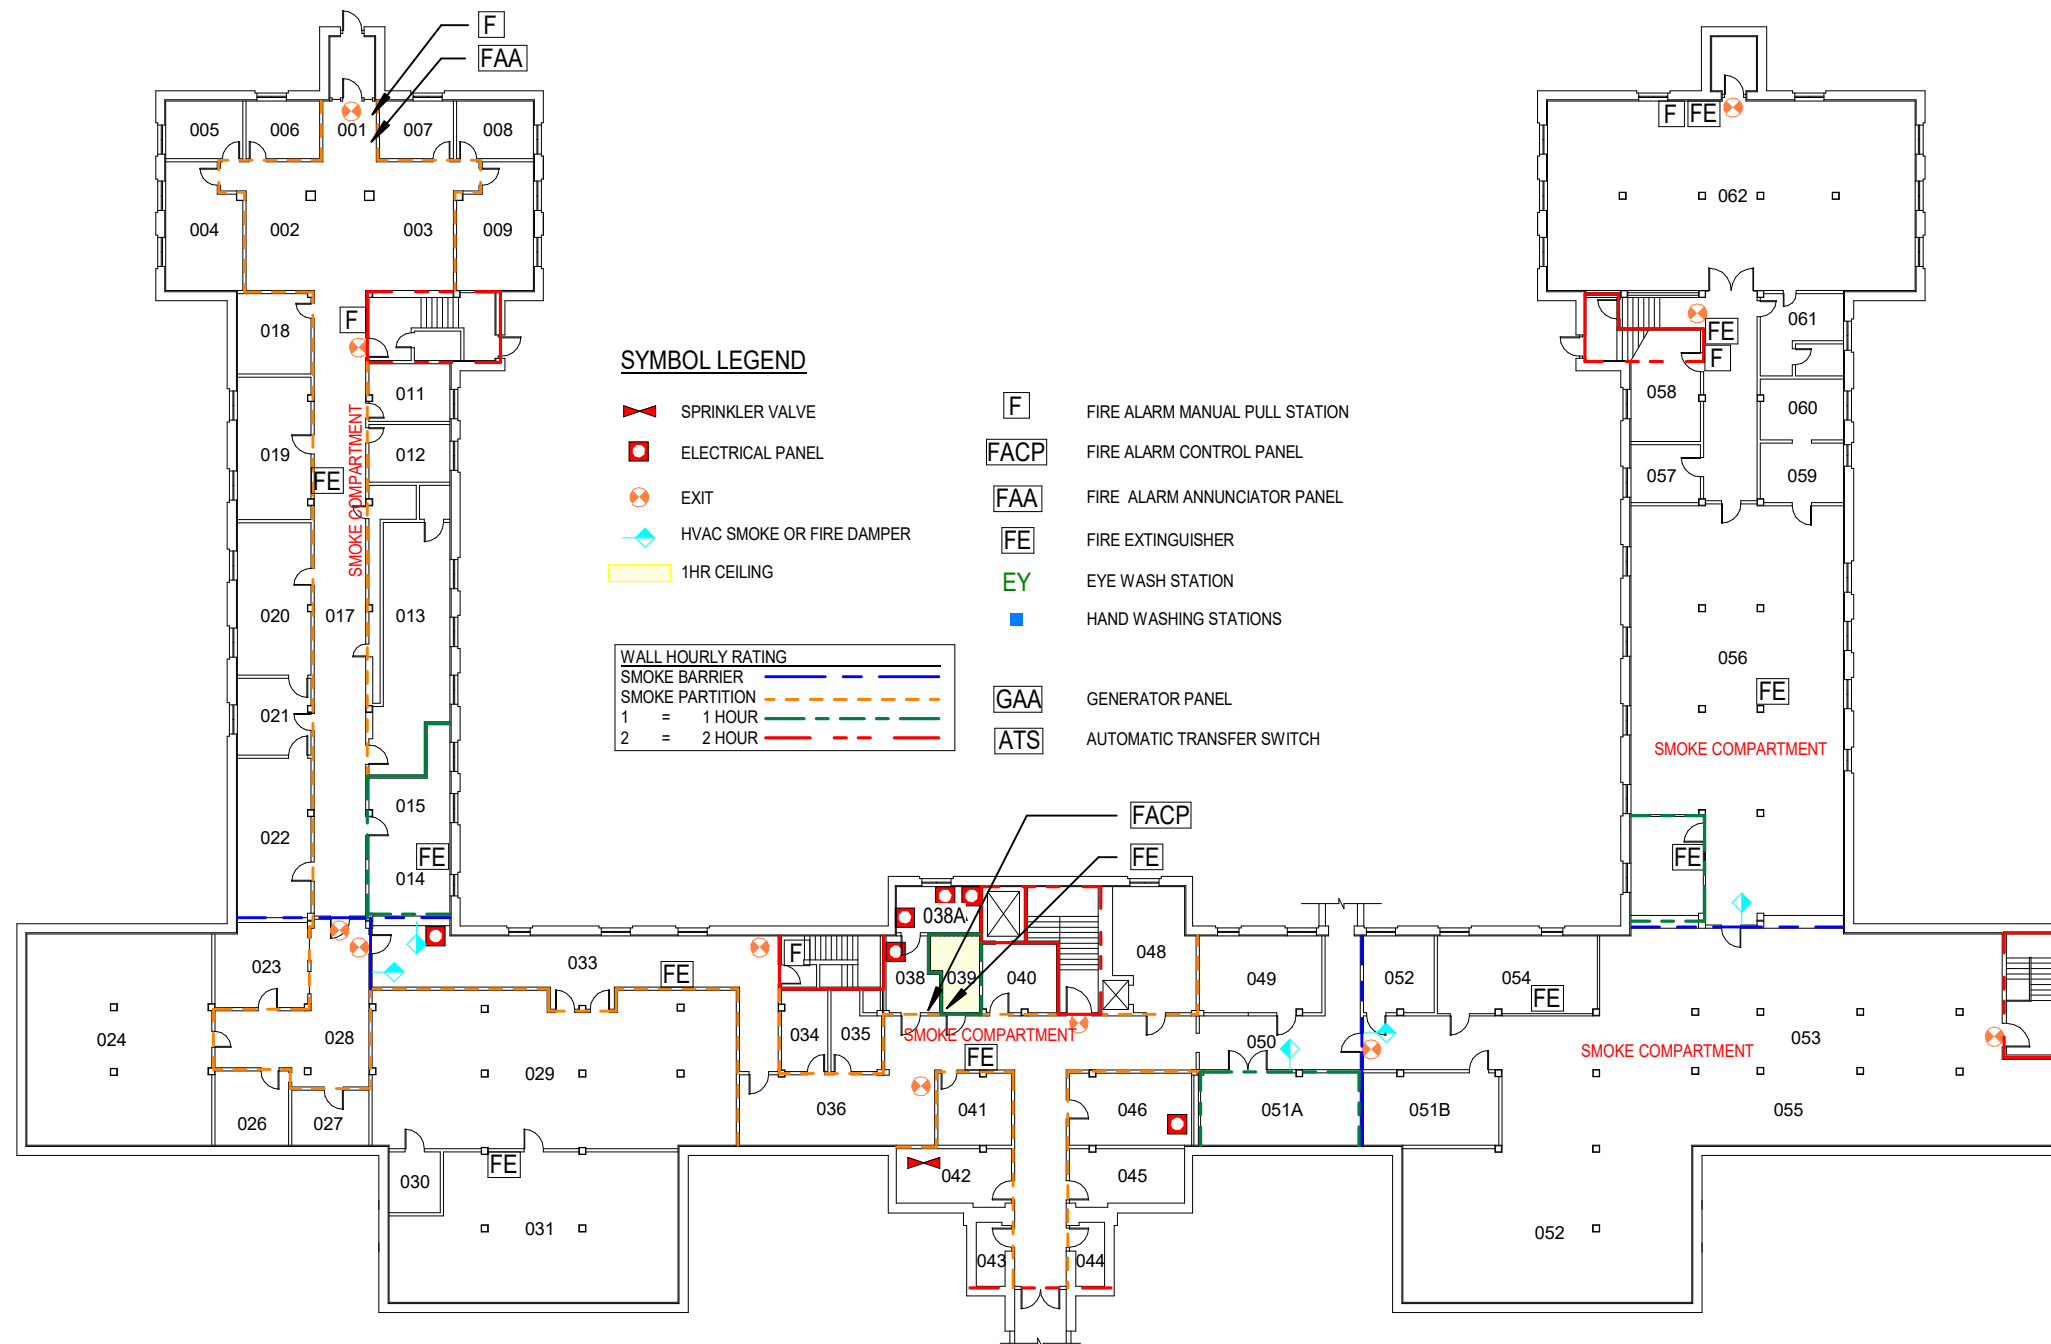

LEVEL 00
SCALE: 1" = 30'-0"


BUILDING #14
LINCOLN REGIONAL CENTER
LINCOLN, NEBRASKA

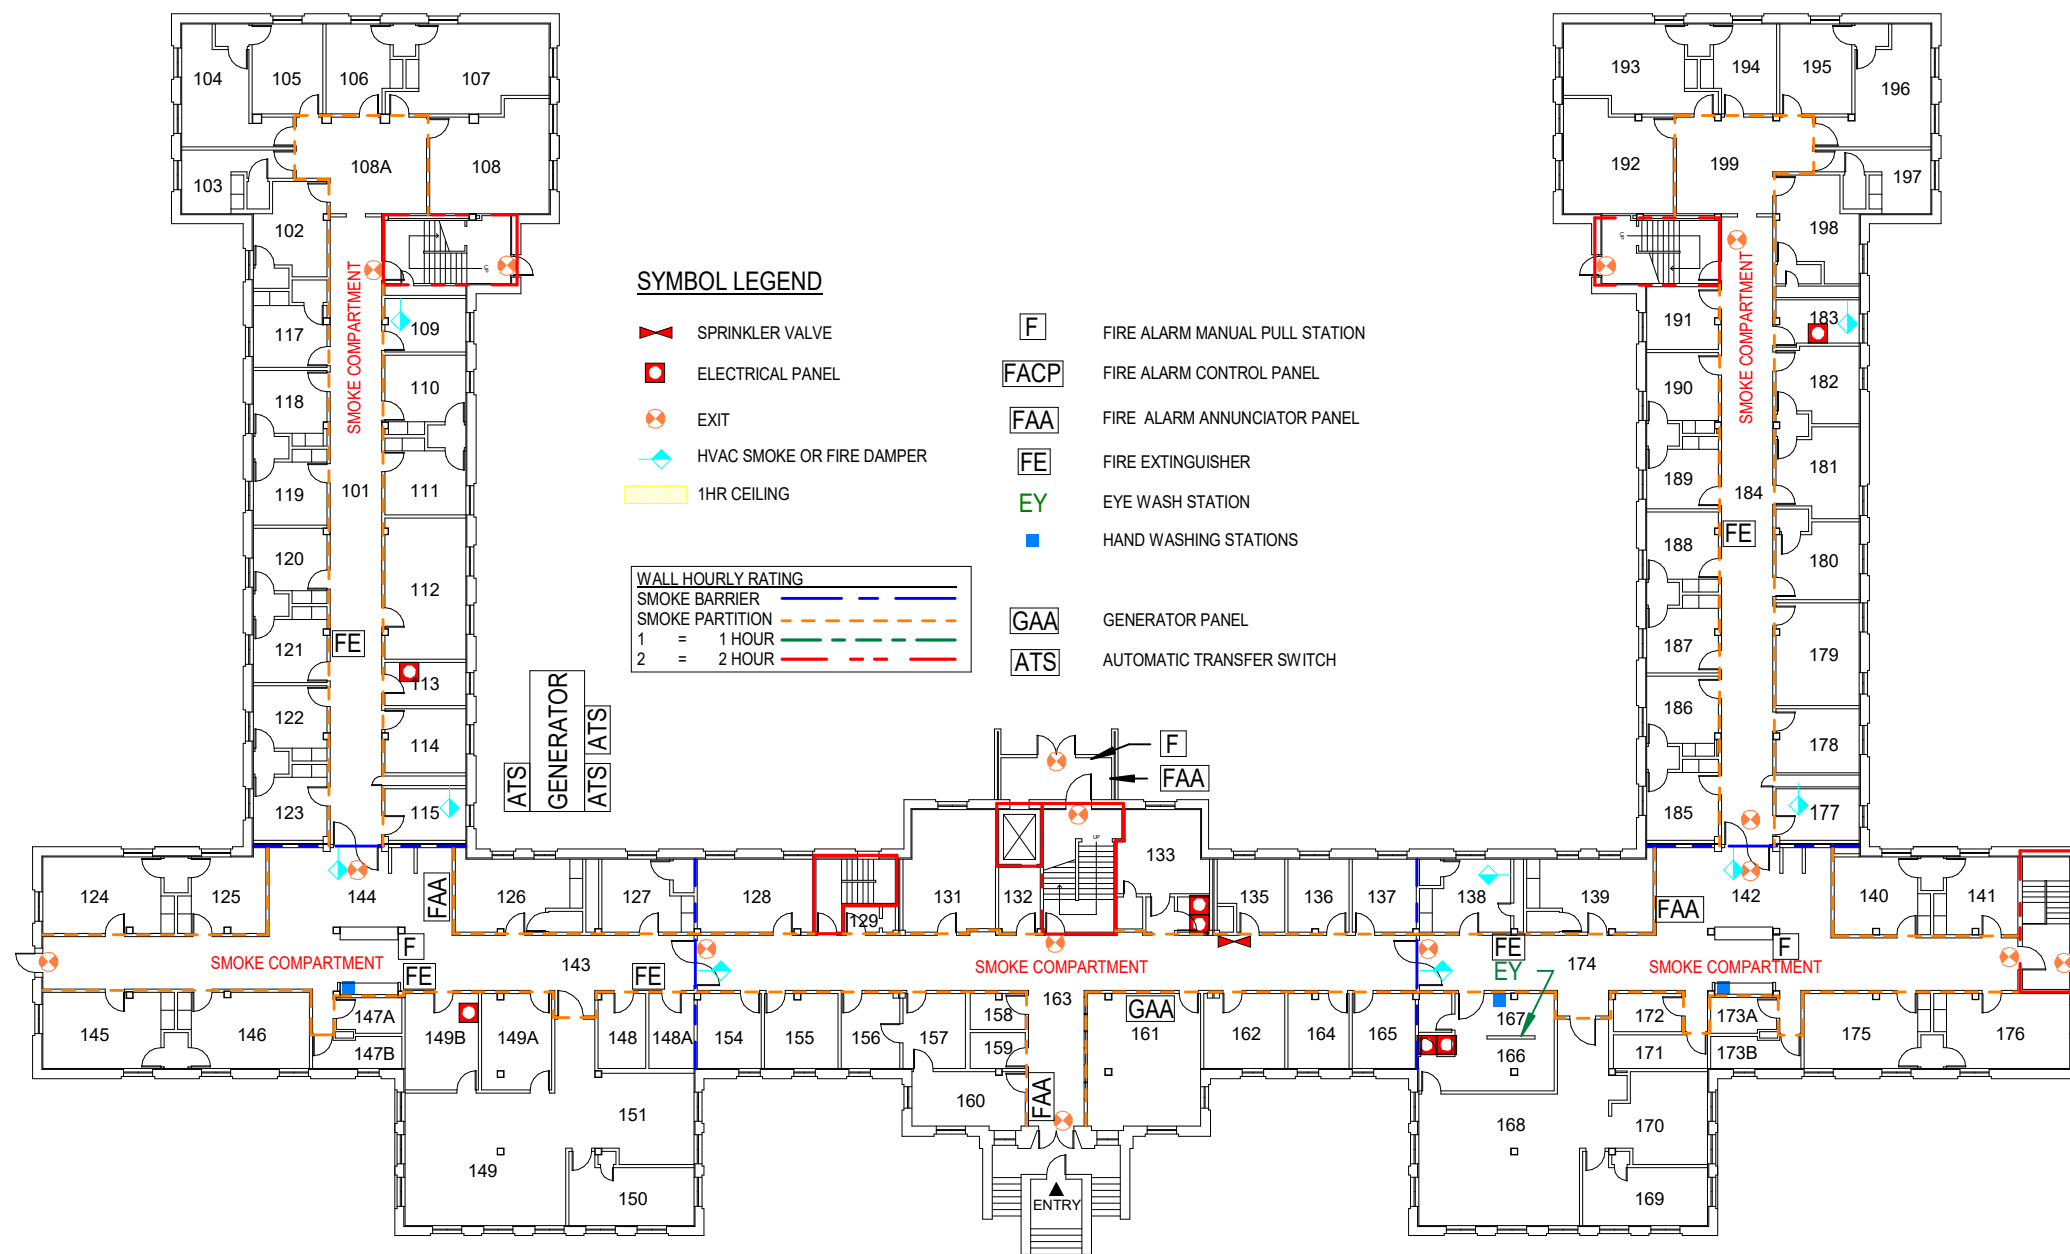

LEVEL 01
SCALE: 1" = 30'-0"


BUILDING #14
LINCOLN REGIONAL CENTER
LINCOLN, NEBRASKA

HALLWAY WIDTH EXCEPTION BY
EQUIVALENCY REQUEST STATE - S0039

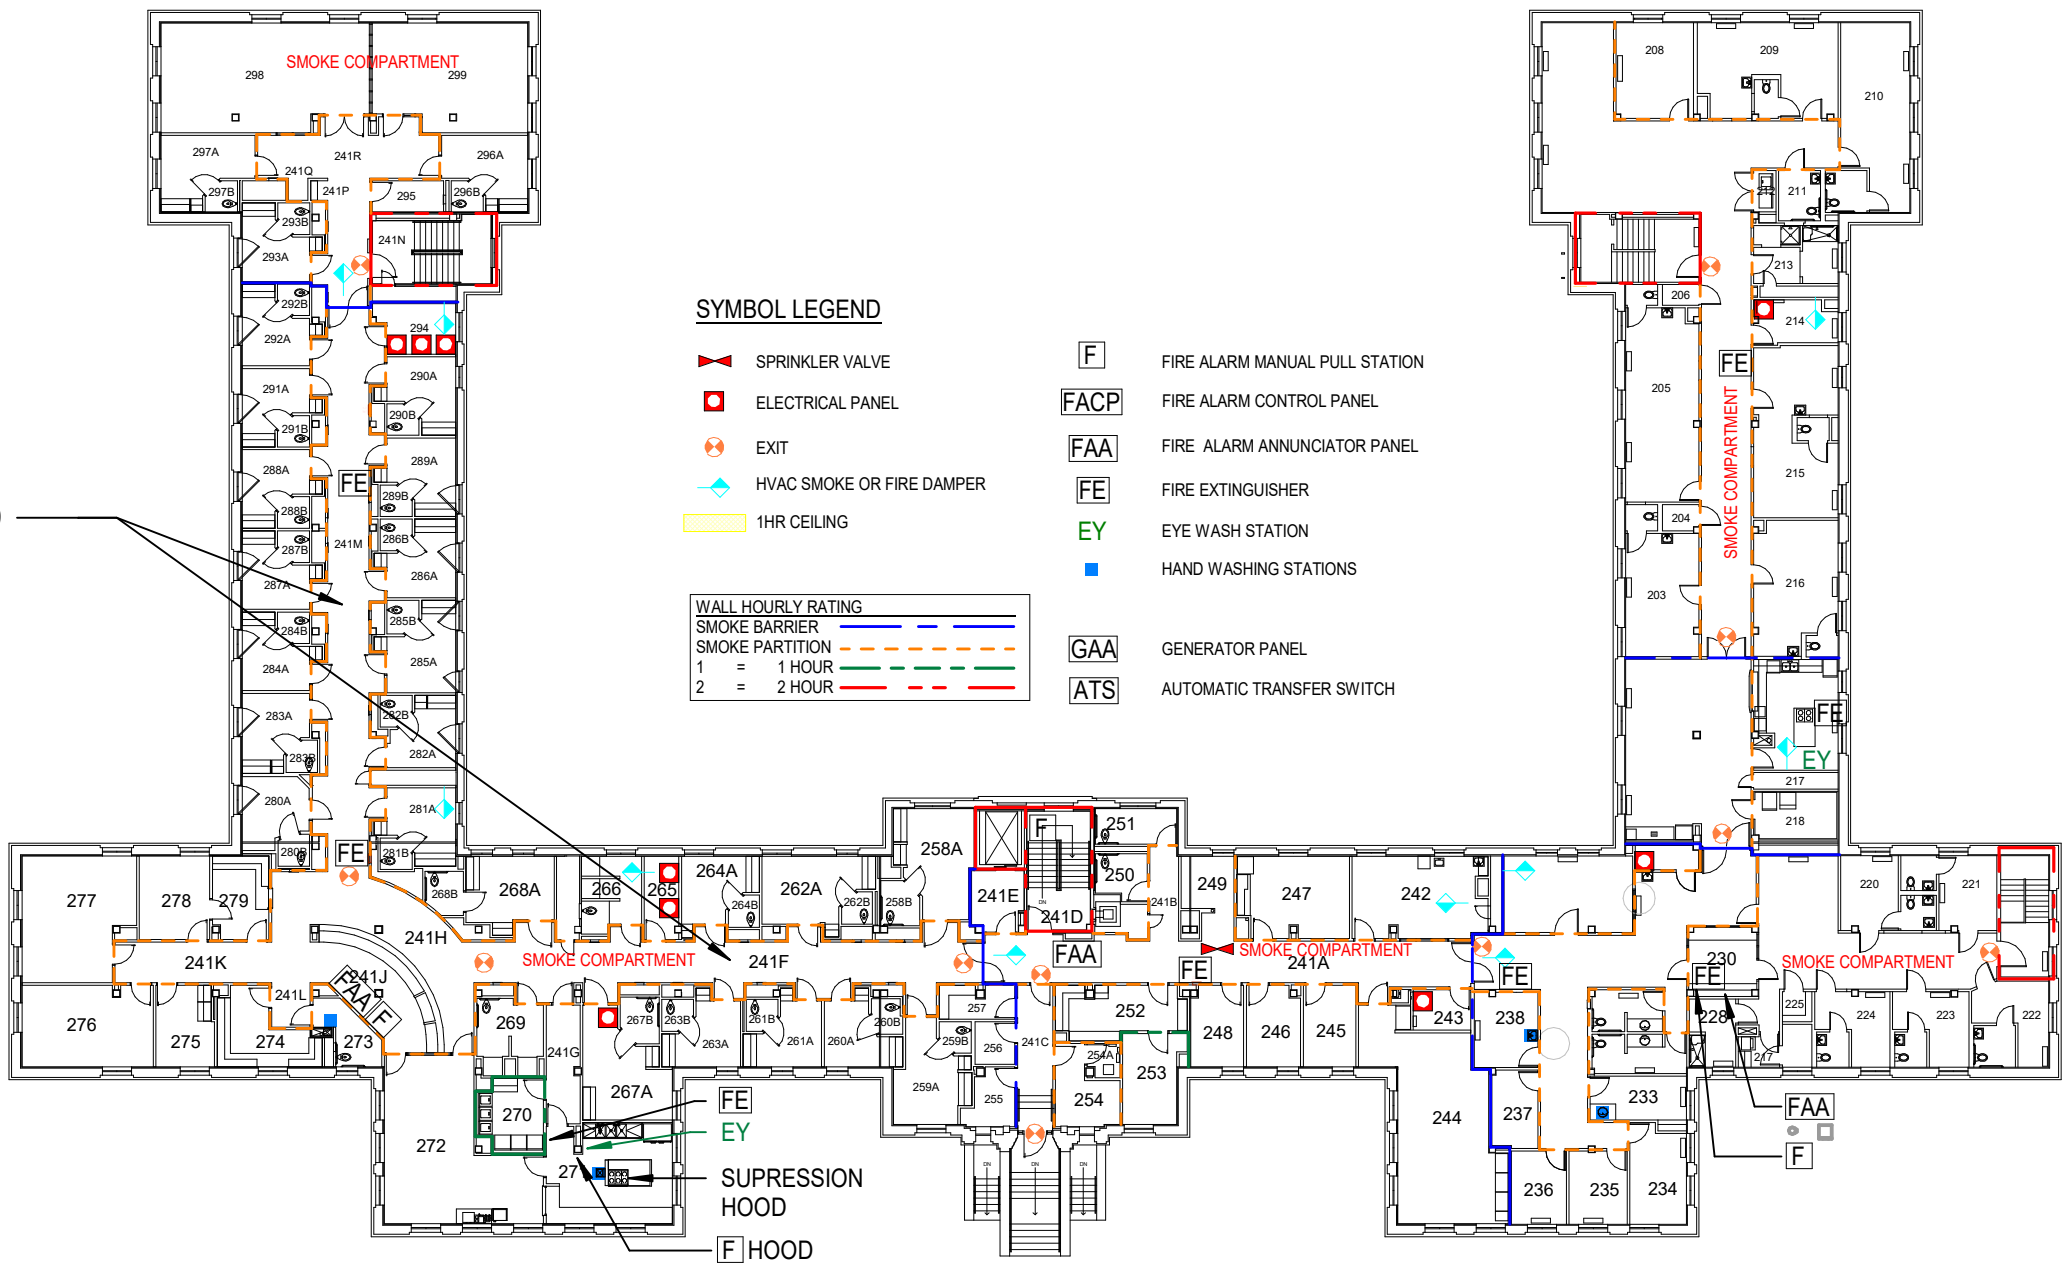

LEVEL 02
SCALE: 1" = 30'-0"

BUILDING #14
LINCOLN REGIONAL CENTER
LINCOLN, NEBRASKA

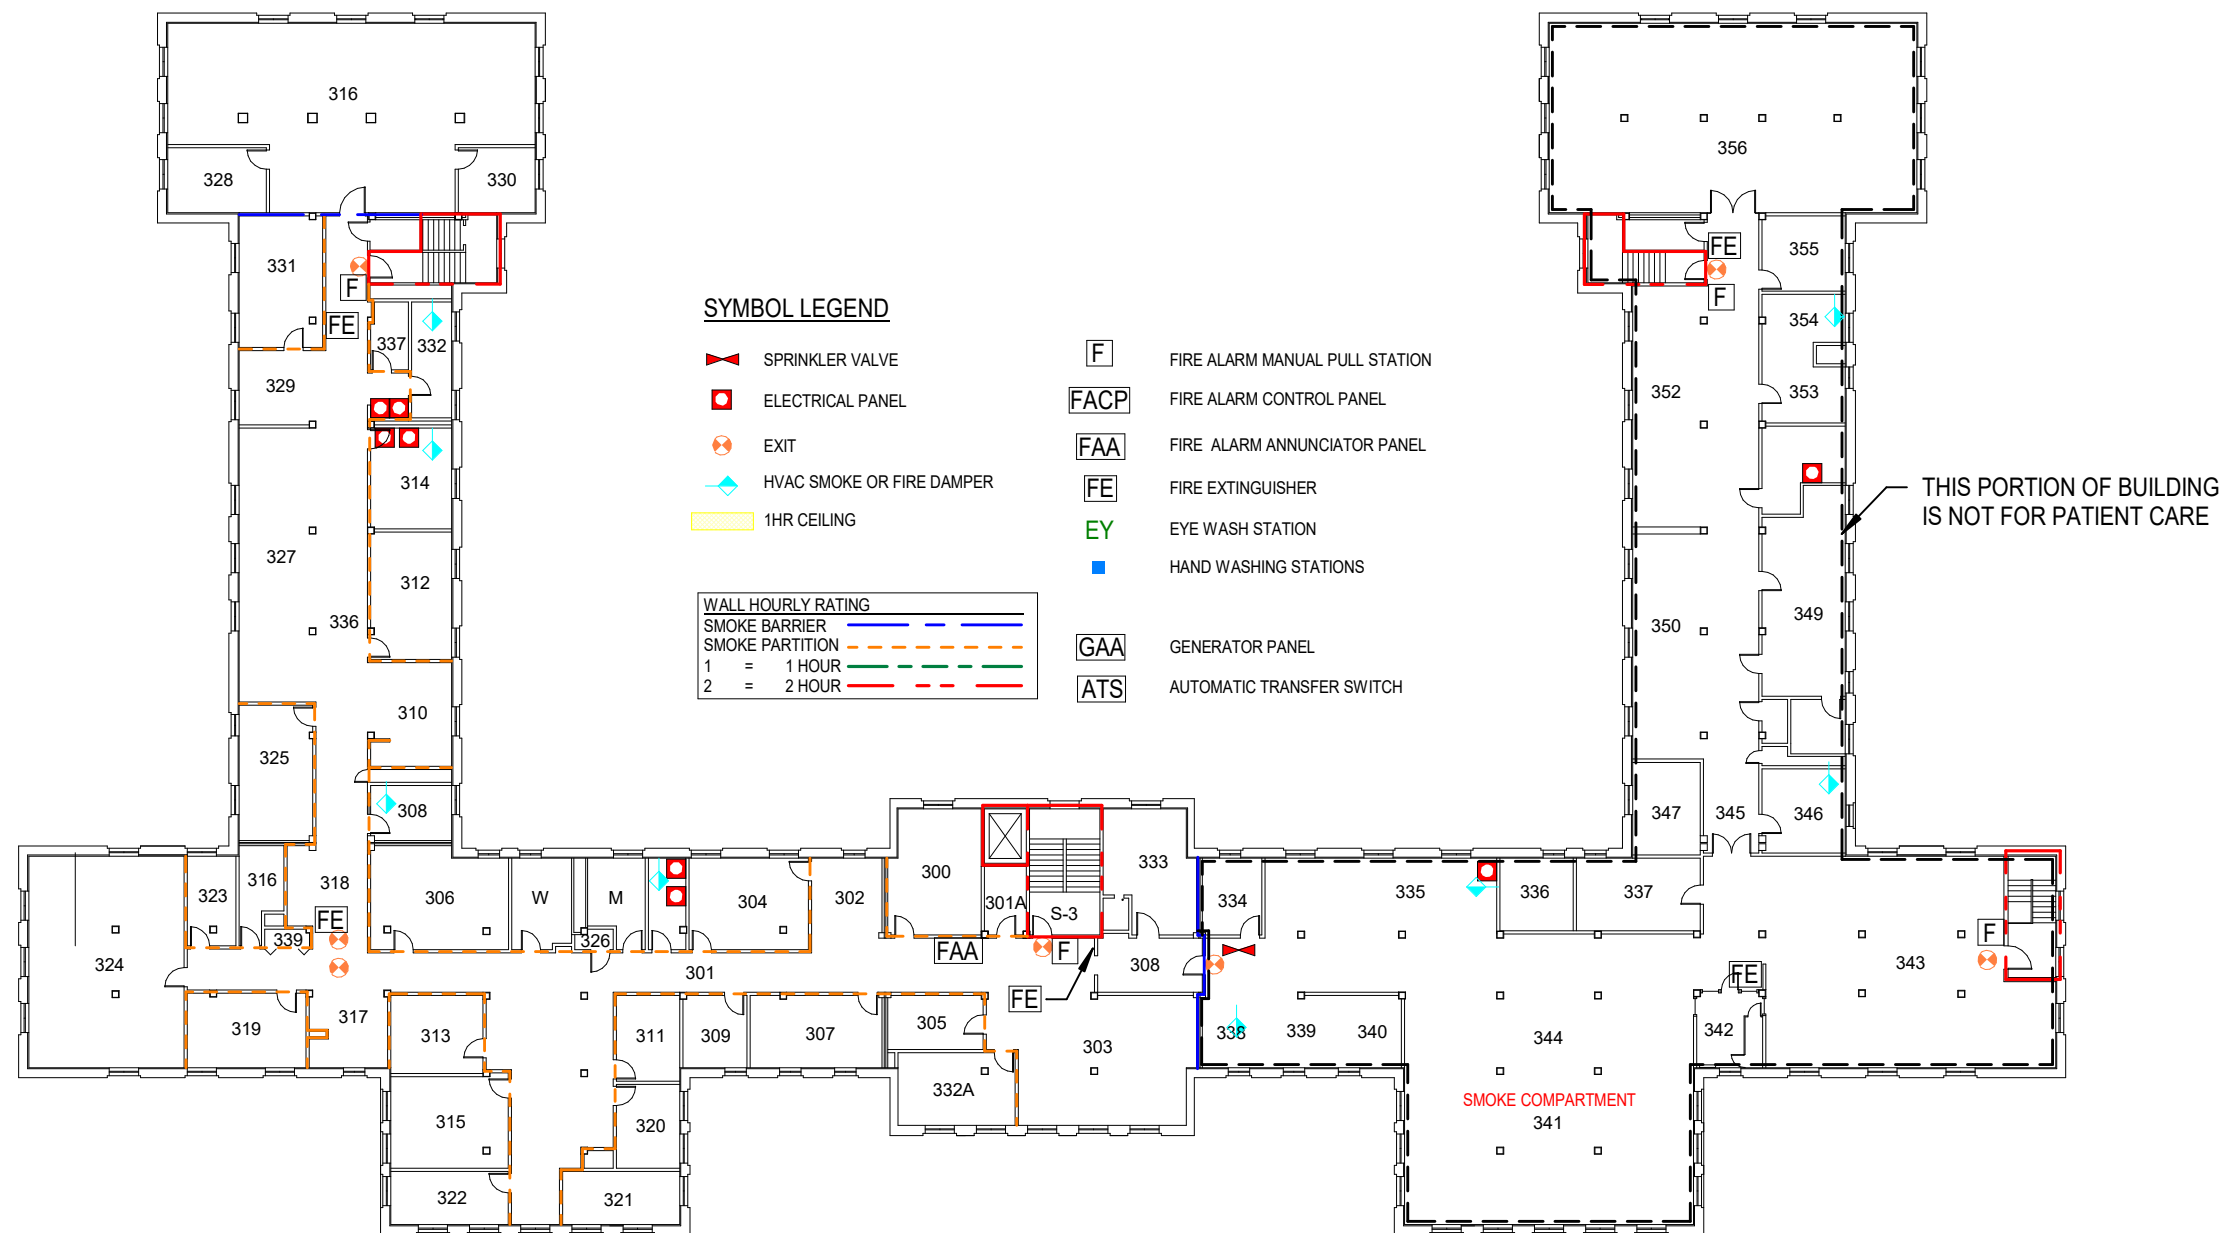

LEVEL 03
SCALE: 1" = 30'-0"



BUILDING #14
LINCOLN REGIONAL CENTER
LINCOLN, NEBRASKA

SYMBOL LEGEND

- SPRINKLER VALVE
- ELECTRICAL PANEL
- EXIT
- HVAC SMOKE OR FIRE DAMPER
- 1HR CEILING

WALL HOURLY RATING	
SMOKE BARRIER	---
SMOKE PARTITION	---
1 = 1 HOUR	---
2 = 2 HOUR	---

- FIRE ALARM MANUAL PULL STATION
- FIRE ALARM CONTROL PANEL
- FIRE ALARM ANNUNCIATOR PANEL
- FIRE EXTINGUISHER
- EYE WASH STATION
- HAND WASHING STATIONS
- GENERATOR PANEL
- AUTOMATIC TRANSFER SWITCH

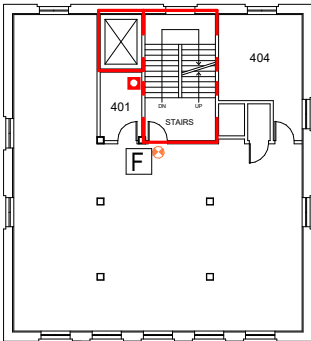

PENTHOUSE
SCALE: 1" = 30'-0"

LEVEL 04
SCALE: 1" = 30'-0"